


|                                        |                        |                                                               |
|----------------------------------------|------------------------|---------------------------------------------------------------|
| WAAS<br>CH <b>56415</b><br><b>W30A</b> | APP CRS<br><b>298°</b> | Rwy Idg <b>5320</b><br>TDZE <b>919</b><br>Apt Elev <b>919</b> |
|----------------------------------------|------------------------|---------------------------------------------------------------|

RNAV (GPS) RWY 30

ANDERSON MUNI-DARLINGTON FLD (AID)

|          |                                                                                                                                                                                                                                                                                                                                                                                          |           |                                                          |
|----------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------|----------------------------------------------------------|
| RNP APCH | For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -16°C (4°F) or above 47°C (116°F). When local altimeter setting not received, use Muncie altimeter setting and increase all DA 32 feet and all MDA 40 feet, and increase LPV and LNAV/VNAV all Cats and LNAV Cat C visibility ¼ mile. Inoperative table does not apply.<br>Rwy 30 helicopter visibility reduction below ¾ SM NA. | MALSF<br> | MISSED APPROACH:<br>Climb to 3000 direct WARMU and hold. |
|----------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------|----------------------------------------------------------|

|                         |                                             |                                                  |                         |                         |
|-------------------------|---------------------------------------------|--------------------------------------------------|-------------------------|-------------------------|
| AWOS-3<br><b>128.55</b> | INDIANAPOLIS APP CON<br><b>120.65 317.8</b> | ANDERSON TOWER ★<br><b>126.0</b> (CTAF) <b>0</b> | GND CON<br><b>121.6</b> | UNICOM<br><b>122.95</b> |
|-------------------------|---------------------------------------------|--------------------------------------------------|-------------------------|-------------------------|

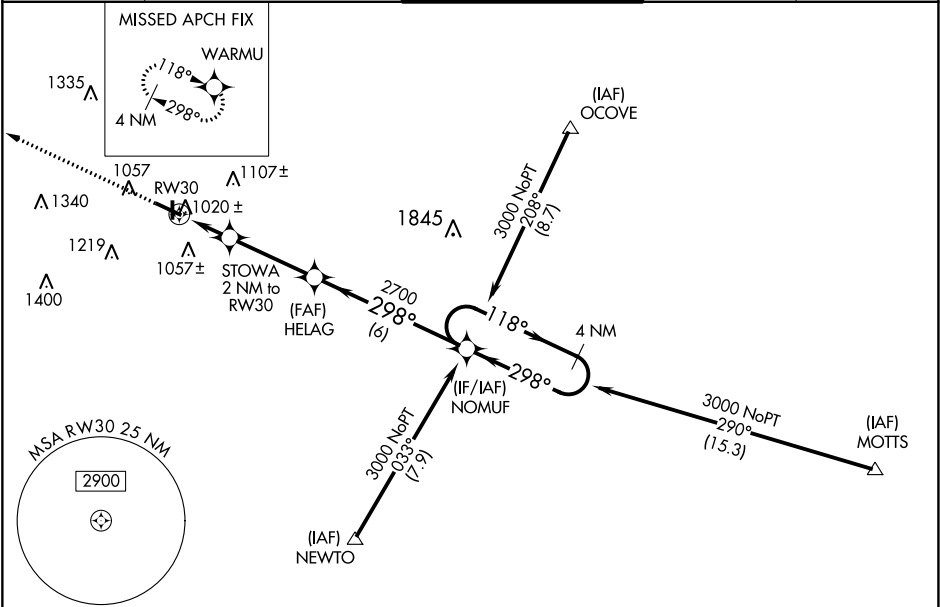

|                 |                 |
|-----------------|-----------------|
| ELEV <b>919</b> | TDZE <b>919</b> |
|-----------------|-----------------|

