

LOC/DME I-SMR
111.3
Chan **50**

APP CRS
032°

Rwy Idg **10502**
TDZE **3680**
Apt Elev **3680**


ILS RWY 3 (SA CAT I)
GREAT FALLS INTL (GTF)

Requires specific OPSPEC, MSPEC, or
LOA approval and use of HUD to DH.
DME required.

ALSIF-2

MISSED APPROACH: Climb to 5000 then climbing right turn
to 8300 direct GTF VORTAC then on GTF VORTAC R-209 to
FRYMN/I-SMR 16.9 DME and hold.

ATIS 126.6 269.0	GREAT FALLS APP CON 128.6 379.175	GREAT FALLS TOWER 118.7 282.2	GND CON 121.7 348.6	CLNC DEL 121.7 348.6
----------------------------	---	---	-------------------------------	--------------------------------

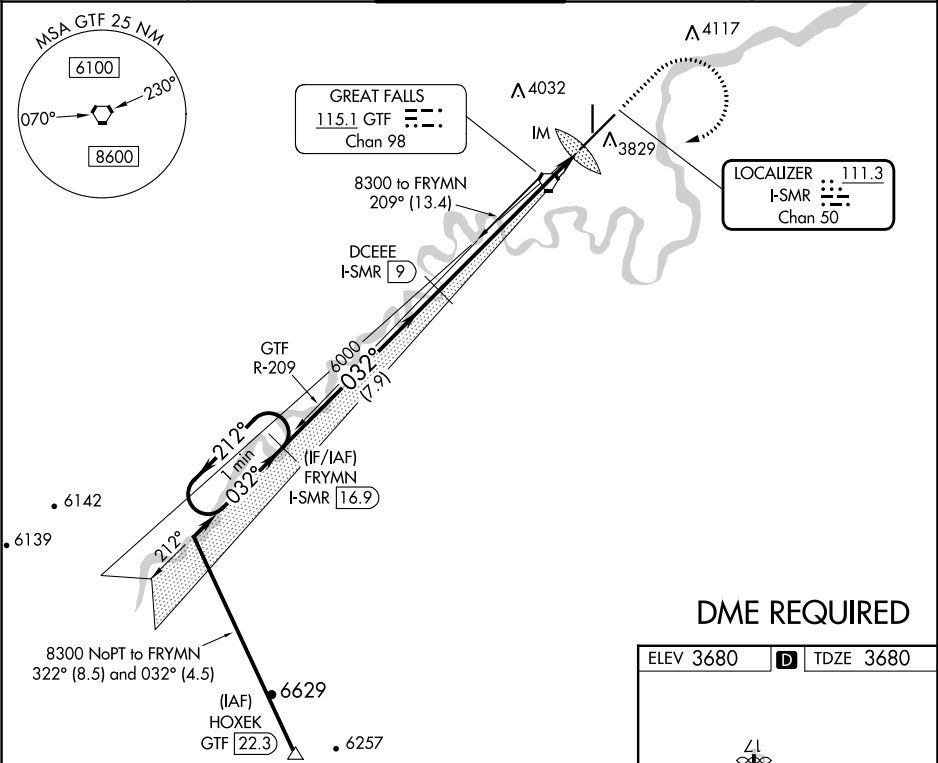

DME REQUIRED

