

APP CRS 227°	Rwy Idg TDZE Apt Elev	8700 50 55
------------------------	-----------------------------	---------------------------------------

RNAV (RNP) Z RWY 23
RHODE ISLAND TF GREEN INTL (PVD)


T For uncompensated Baro-VNAV systems, procedure NA below -15°C (5°F) or above 48°C (118°F). RF required. For inop MALSR, increase RNP 0.30 all Cats visibility to 1¼. GPS Required.



Climb to 2500 on track 227° to WIKIT and right turn to STUFY and on track 013° to FOSTY and hold

D-ATIS 124.2	PROVIDENCE APP CON ★ 123.675 244.875	PROVIDENCE TOWER ★ 120.7 (CTAF) 0 257.8	GND CON 121.9 348.6	CLNC DEL 126.65 348.6
-----------------	---	--	------------------------	--------------------------

RADAR REQUIRED

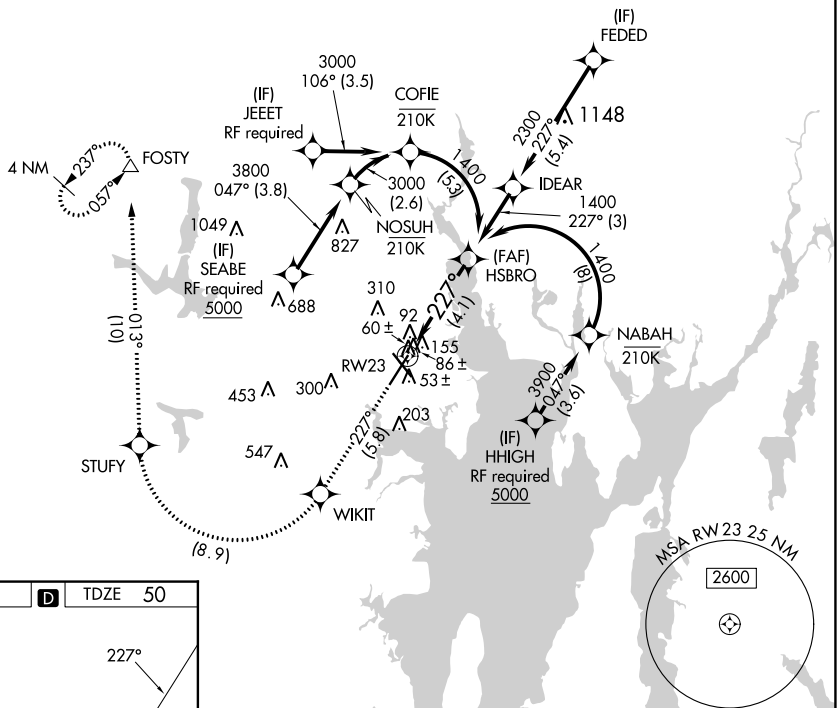

ELEV 55

TDZE 50

227°

036°

8700 X 150

8700 X 150

TWR 134

TDZ/CL Rwy 5

REIL Rwy 16

HIRL Rws 5-23 and 16-34

2500 ↑ tr 227°	WIKIT ✦	STUFY ✦	tr 013°	FOSTY △	HSBRO 1400
VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 41). RW23 227° 1400 See planview for multiple IF locations. 4.1 NM GP 3.00° TCH 5T					
CATEGORY	A	B	C	D	
RNP 0.30 DA	434/40 384 (400-¾)				
AUTHORIZATION REQUIRED					