

APP CRS
230°

Rwy Idg
7100

TDZE
2552

Apt Elev
2567

RNAV (RNP) Z RWY 23

PULLMAN/MOSCOW RGNL (PUW)

RNP AR APCH. RF required.


▼

▲ NA

For uncompensated Baro-VNAV systems, procedure NA below -20°C or above 50°C.

MISSED APPROACH: Climb to 5000 on track 230° to WAZOO and hold.

ASOS 135.675	SEATTLE CENTER 123.95 290.55	UNICOM 122.8 (CTAF) 0
------------------------	--	---------------------------------

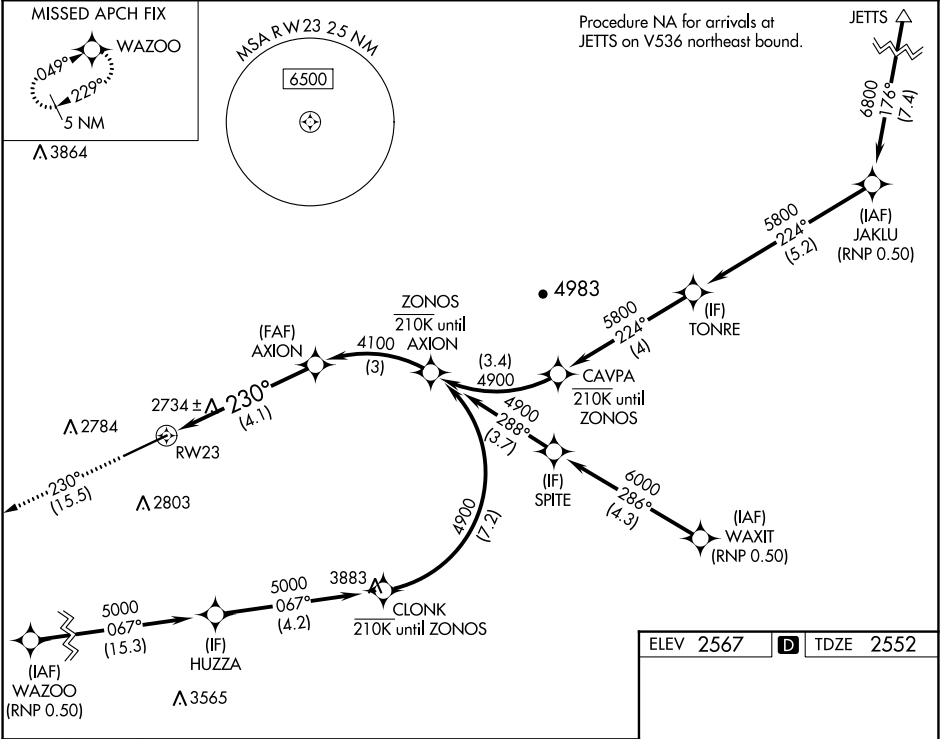

5000

↑

tr 230°

WAZOO



See planview for multiple IF locations.

AXION

4100

4100

GP 3.40°

TCH 59

RW23



4.1 NM

230°

CATEGORY	A	B	C	D
RNP 0.22 DA	3041-1 ³ / ₈	489 (500-1 ³ / ₈)		
RNP 0.30 DA	3146-1 ³ / ₄	594 (600-1 ³ / ₄)		

AUTHORIZATION REQUIRED

REIL Rwy 23 0

HIRL Rwy 5-23 0

ELEV 2567

D

TDZE 2552

