

LOC/DME I-TLH 110.3 Chan 40	APP CRS 004°	Rwy Idg 7000 TDZE 62 Apt Elev 83
--	------------------------	---


ILS Z or LOC Z RWY 36

TALLAHASSEE INTL (TLH)



DME required. RADAR required for procedure entry at CVILL.
 * RVR 1800 authorized with use of FD or AP or HUD to DA.
 ASR

MALSR
 MISSED APPROACH: Climb to 4000 direct SZW VORTAC and hold, continue climb-in-hold to 4000.

ATIS 119.45 239.25	TALLAHASSEE APP CON * 135.8 317.4	TALLAHASSEE TOWER * 118.7 (CTAF) 0 257.8	GND CON 121.9 348.6	CLNC DEL 126.65 275.8	UNICOM 123.075
------------------------------	---	--	-------------------------------	---------------------------------	--------------------------

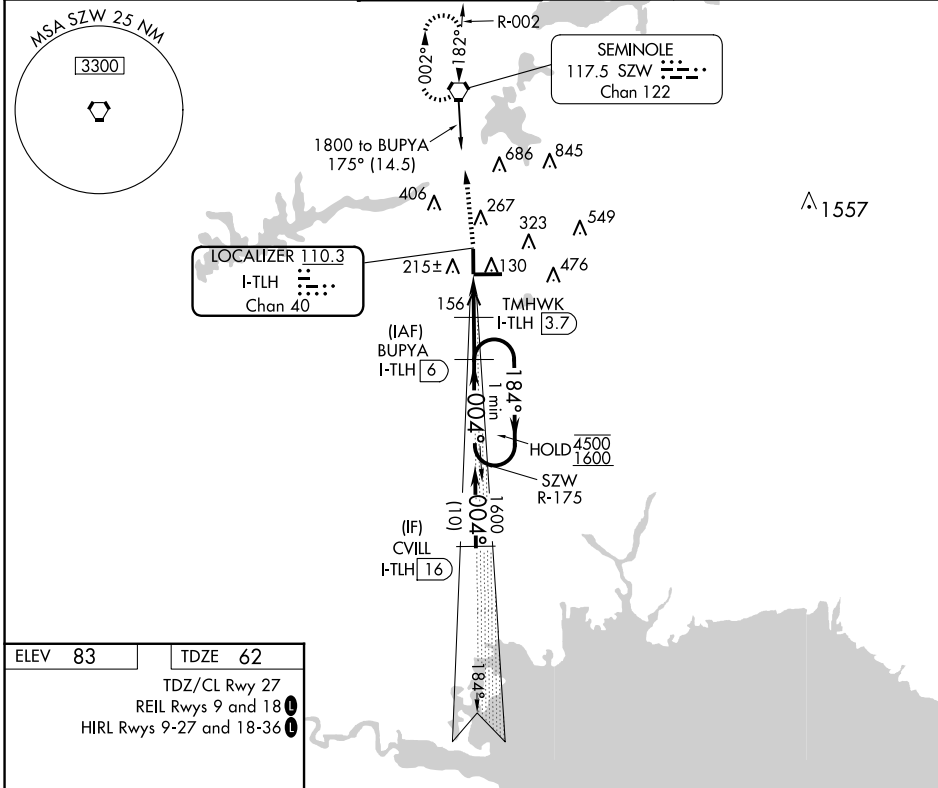

ELEV 83	TDZE 62
TDZ/CL Rwy 27	
REIL Rwy 9 and 18	
HIRL Rwy 9-27 and 18-36	

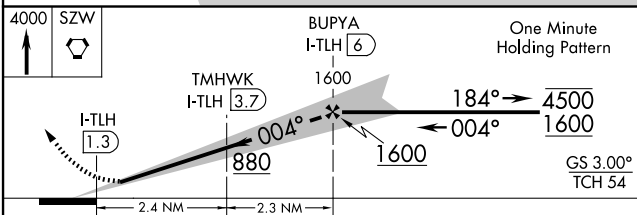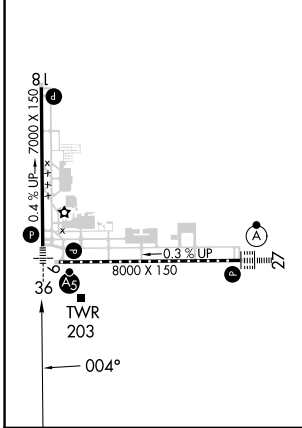

CATEGORY	A	B	C	D
S-ILS 36 *	262/24		200 (200-1/2)	
S-LOC 36	460/24	398 (400-1/2)	460/35	398 (400-5/8)
CIRCLING	580-1 497 (500-1)	600-1 517 (600-1)	640-1 1/2 557 (600-1 1/2)	800-2 1/4 717 (800-2 1/4)

SE-3, 20 FEB 2025 to 20 MAR 2025

SE-3, 20 FEB 2025 to 20 MAR 2025