

WAAS

CH **65744**

W23A

APP CRS

233°

Rwy Idg

7543

TDZE

710

Apt Elev

716

RNAV (GPS) RWY 23

WILLOW RUN (YIP)

RNP APCH - GPS.

▼

▲


For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to ¾ SM, LNAV Cats C/D visibility to 1 SM.

MALSR


MISSED APPROACH:

Climb to 3000 direct ZAVEX and hold, continue climb-in-hold to 3000.


ATIS 127.425	DETROIT APP CON 118.95 284.0	WILLOW RUN TOWER 125.275 256.9	GND CON 119.975
------------------------	--	--	---------------------------

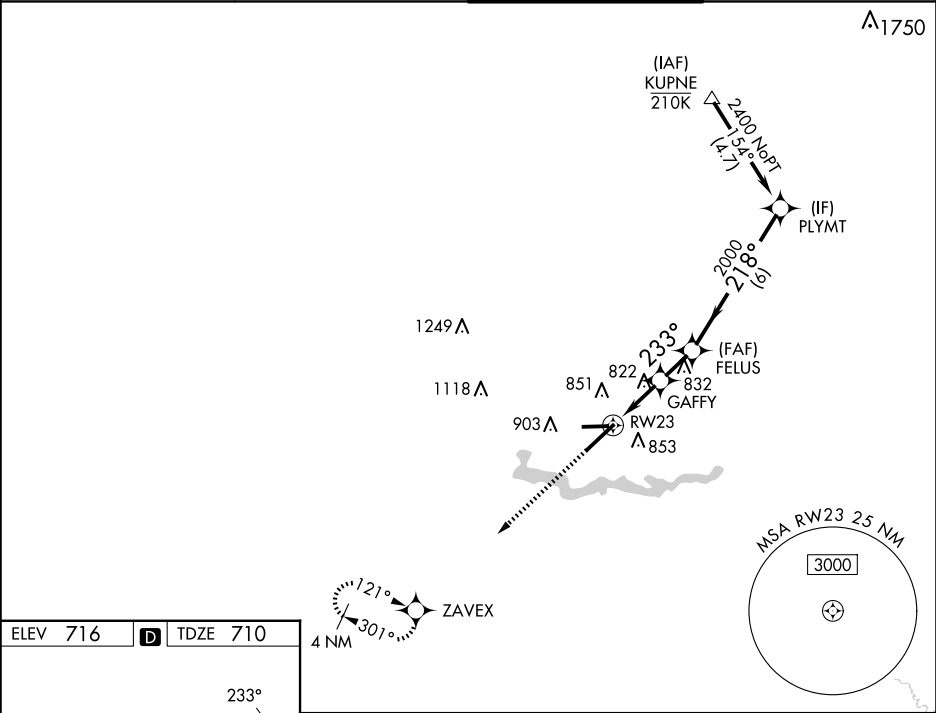

ELEV 716	D	TDZE 710
-----------------	----------	-----------------

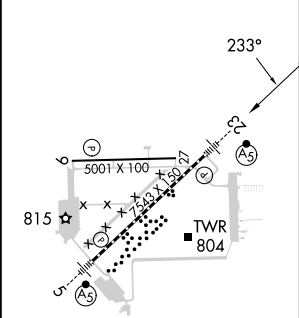

TDZ/CL Rwy 5
HIRL Rwy 5-23
MIRL Rwy 9-27

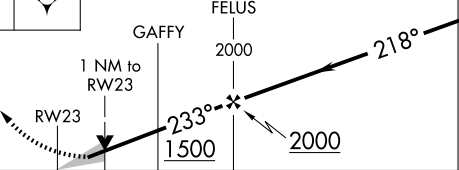3000 ↑		ZAVEX 			
				GP 3.00° TCH 57	
CATEGORY	A		B	C	D
LPV DA	910-½		200 (200-½)		
LNAV/ VNAV DA	982-½		272 (300-½)		
LNAV MDA	1080-½	370 (400-½)	1080-⅝		370 (400-⅝)
 CIRCLING	1220-1	504 (600-1)	1220-1½ 504 (600-1½)	1400-2¼ 684 (700-2¼)	