ILS or LOC RWY 36

OCALA INTL-JIM TAYLOR FLD (OCF)

LOC I-OCF	APP CRS	Rwy ldg	6347
111.5	004°	TDZE	80
		Apt Elev	90

DME required.

DME from OCF VORTAC. DME use requires simultaneous reception of I-OCF and OCF DME. Inop table does not apply to S-ILS 36 all Cats. For inop ALS, increase S-LOC 36 Cats A and B visibility to 1 SM.

MALSR

MISSED APPROACH: Climb to 2000 on OCF VORTAC R-355 to JODON/OCF VORTAC 16 DME and hold.

ATIS	JACKSONVILLE APP CON	OCALA TOWER ★	GND CON
128.125	118.6 251.15	119.25 (CTAF) L	121.4

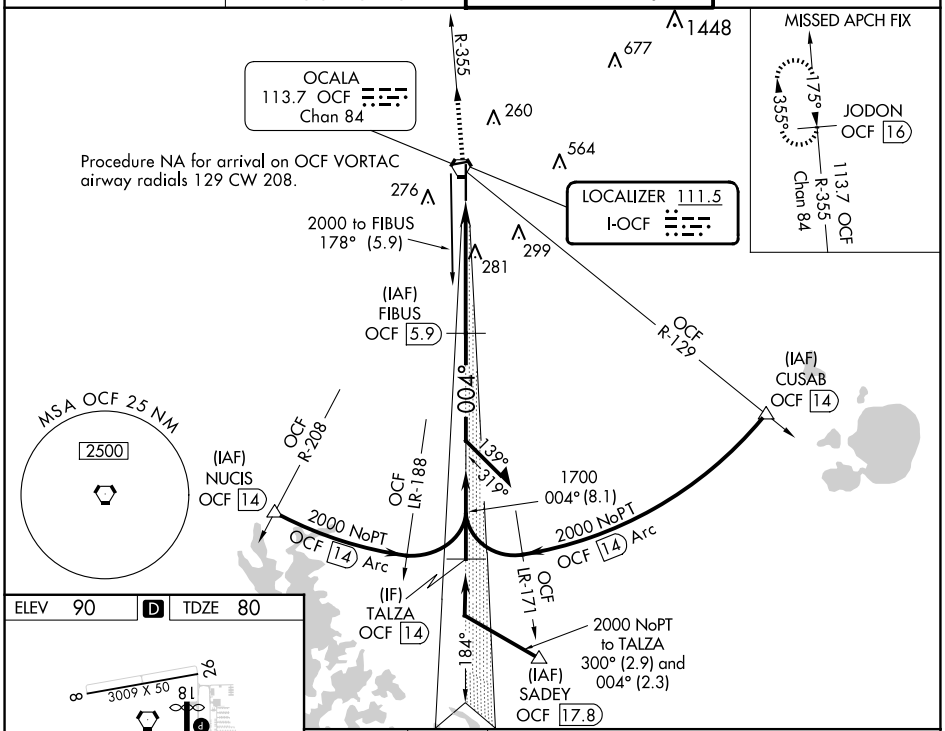

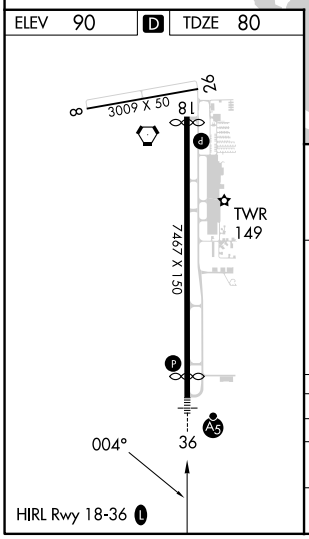

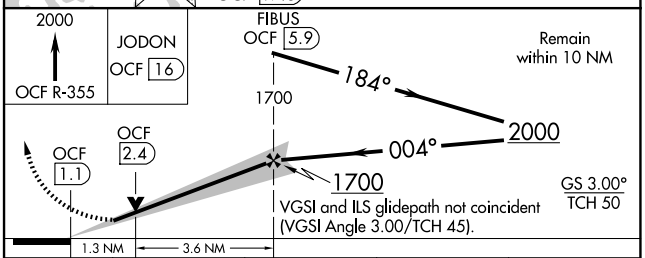

CATEGORY	A	B	C	D
S-ILS 36	280-¾ 200 (200-¾)			
S-LOC 36	540-¾ 460 (500-¾)		540-⅞ 460 (500-⅞)	
CIRCLING	600-1 510 (600-1)		760-1¾ 670 (700-1¾)	920-2¾ 830 (900-2¾)