


APP CRS 036°	Rwy Ldg 10001 TDZE 633 Apt Elev 645
------------------------	--

RNAV (RNP) W RWY 3R
DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH.			ALSF-2 		MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAUGE and hold.	
 For uncompensated Baro-VNAV systems, procedure NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized.						
D-ATIS 133.675	DETROIT APP CON 125.15 284.0	METRO TOWER 118.4 317.725	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)		CLNC DEL 120.65	CPDLC

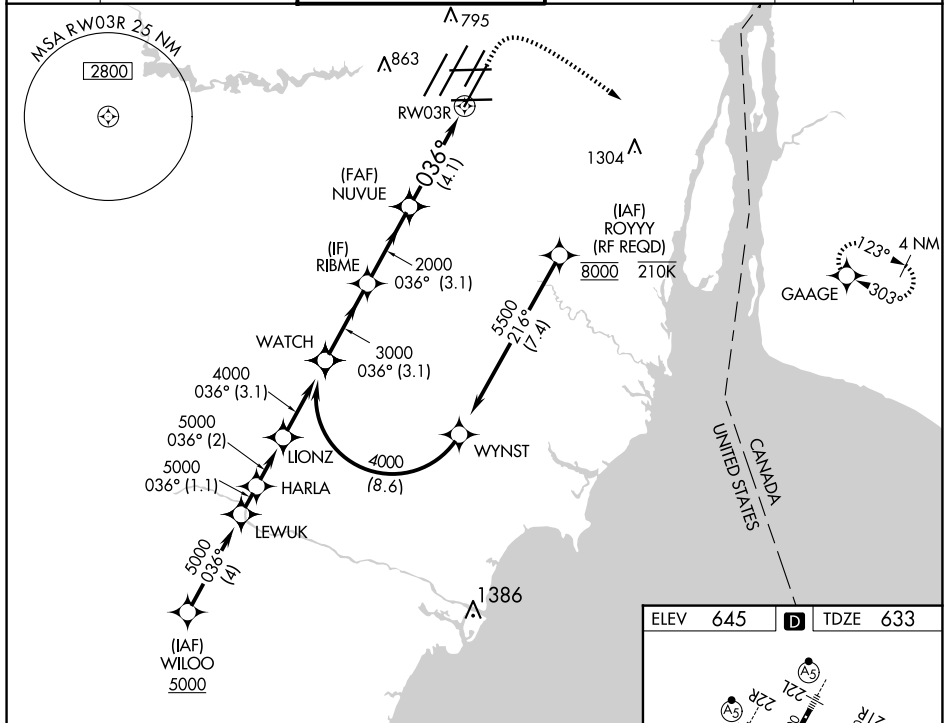

VGS and RNAV glidepath not coincident
(VGS Angle 3.00/TCH 70).

WATCH

4000 036°

RIBME

3000

NUVUE

2000

2000

RW03R

GP 3.00°
TCH 54

3.1 NM 3.1 NM 4.1 NM

CATEGORY	A	B	C	D
RNP 0.30 DA	1021/35 388 (400-5%)			

AUTHORIZATION REQUIRED

HRL all runways
REIL Rwy 3L, 9L, 9R and 21R
TDZ/CL Rwy 3R, 4L, 4R and 22R