

APP CRS

036°

Rwy Ldg

10000

TDZE

645


Apt Elev

645

RNAV (RNP) X RWY 4L

DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH.		ALS-F-2		MISSED APPROACH: Climb to 1100 then climbing left turn to 4000 direct DOHNT and hold.	
Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase RNP 0.30 DA all Cnts visibility to RVR 6000.					
D-ATIS	DETROIT APP CON	METRO TOWER	GND CON	CLNC DEL	CPDLC
133.675	124.05 284.0	135.0 317.725	121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)	120.65	

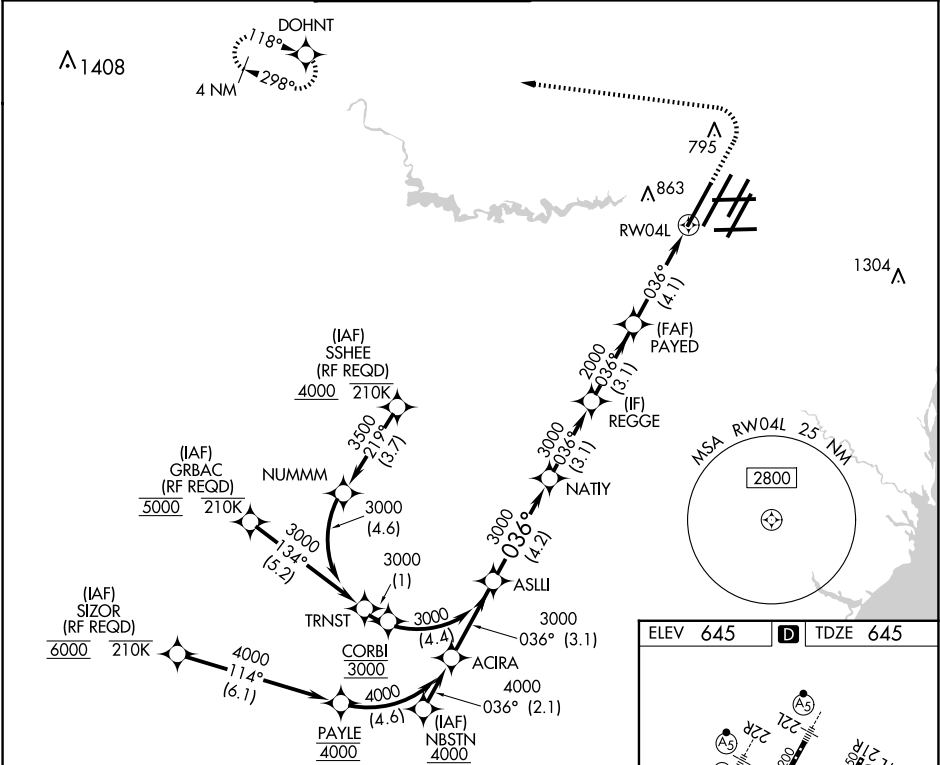

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 71).

1100

4000

DOHNT

ASLLI

NATY

REGGE

PAYED

RW04L

3000

3000

3000

2000

GP 3.00°

TCH 55

4.2 NM

3.1 NM

3.1 NM

4.1 NM

CATEGORY	A	B	C	D
RNP 0.15 DA		970/26	325 (400-½)	
RNP 0.30 DA		1058/40	413 (500-¾)	

AUTHORIZATION REQUIRED

ELEV 645

D

TDZE 645

036°

TDZ/CL Rwy 3R, 4L, 4R and 22R

REL Rwy 3L, 9L, 9R and 21R

HIRL all runways