

APP CRS	Rwy Ldg	11200
050°	TDZE	747
	Apt Elev	796

RNAV (RNP) Z RWY 5L

INDIANAPOLIS INTL (IND)

▼


For uncompensated Baro-VNAV systems, procedure NA below -18°C (0°F) or above 54°C (130°F). GPS required. For inop ALS, increase RNP 0.30 all Cats visibility to 1½ SM. Simultaneous approach authorized.

ALS-2

MISSED APPROACH:

Climbing left turn to 3000 direct KEADY and hold.

D-ATIS	INDIANAPOLIS APP CON	INDY TOWER	GND CON	CLNC DEL	CPDLC
134.25	128.175 317.8	120.9 251.1	121.9	128.75 251.1	

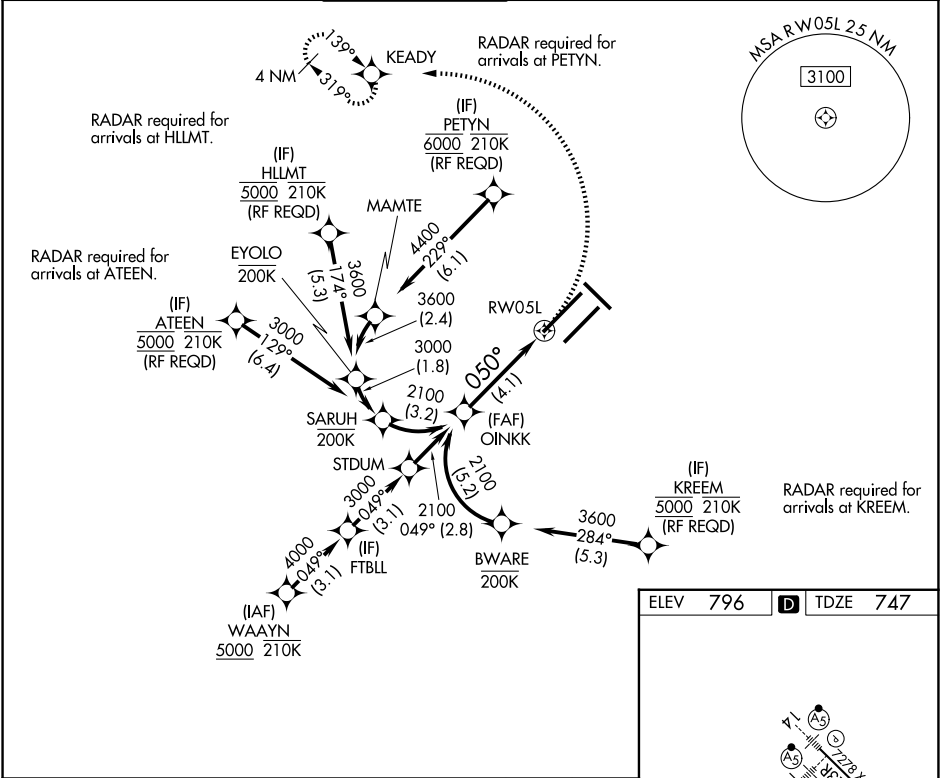

OINKK

2100

GP 3.00° TCH 53

2100

050°

RW05L

4.1 NM

See planview for multiple IF locations.

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 74).

3000 KEADY

CATEGORY

A

B

C

D

RNP 0.30 DA

1197/60

450 (500-1½)

AUTHORIZATION REQUIRED

ELEV 796

TDZE 747

HIRL all Rwys
TDZ/CL Rwys 5L and 5R