

WAAS

CH **78409**

W09A

APP CRS

095°

Rwy Ldg

10002

TDZE

55

Apt Elev

55

RNAV (GPS) RWY 9L

ORLANDO SANFORD INTL (SF'B)

RNP APCH

▼


▲

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below 0°C or above 54°C. Baro-VNAV and VDP NA when using Orlando Exec altimeter setting. When local altimeter setting not received, use Orlando Exec altimeter setting and increase LPV DA to 282, LNAV/VNAV DA to 501 and all MDA 60 feet; increase LNAV/VNAV all Cats visibilities ½ SM and LNAV Cat C/D visibility ¼ SM. Night landing: Rwy 27C NA.

MALSR

MISSED APPROACH: Climb to 1600 direct UXFIM and hold.

ATIS 125,975	ORLANDO APP CON 135.3 351.9 (N) 125,225 351.9 (S)	SANFORD TOWER ★ 120.3 (CTAF) 0 254.35	GND CON 121.35 254.35
------------------------	---	---	---------------------------------

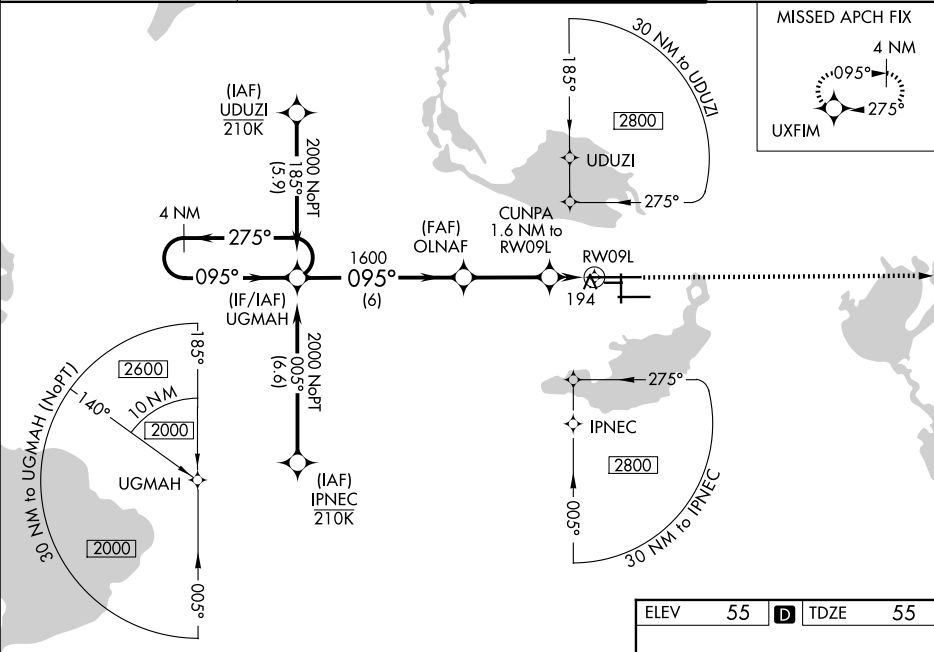

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 71).

4 NM Holding Pattern UGMAH

GP 3.00° TCH 55

2000

275°

095°

1600

095°

OLNAF

1600

CUNPA 1.6 NM to RW09L

*1.1 NM to RW09L

RW09L

*600

6 NM

3.1 NM

0.5 NM

1.1 NM

UXFIM

*LNAV only.

CATEGORY	A	B	C	D
LPV DA		255-½	200 (200-½)	
LNAV/VNAV DA		355-½	300 (300-½)	
LNAV MDA	460-½ 405 (500-½)		460-¾ 405 (500-¾)	
CIRCLING	580-1 525 (600-1)		600-1½ 545 (600-1½)	640-2 585 (600-2)

ELEV 55 D TDZE 55

MIRL Rwy 9C-27C and 18-36 L
HIRL Rwy 9L-27R and 9R-27L L
REIL Rws 9C, 18, 27L and 36