

APP CRS	Rwy Ldg	7510
312°	TDZE	43
	Apt Elev	46

RNAV (RNP) Z RWY 31
CORPUS CHRISTI INTL (CRP)


T For uncompensated Baro-VNAV systems, procedure NA below -1°C (31°F) or above 54°C (130°F). GPS and RF required. For inop MALSR, increase RNP 0.14 all Cats visibility to 7/8 mile.

*Missed approach requires minimum climb of 335 feet per NM to 500.

MALSR

MISSED APPROACH: Climb to 2000 on track 312° to ATHIS and hold.

ATIS 126.8	CORPUS APP CON 120.9 348.725	CORPUS TOWER 119.4 257.8	GND CON 121.9 269.15	CLNC DEL 118.55
---------------	---------------------------------	-----------------------------	-------------------------	--------------------

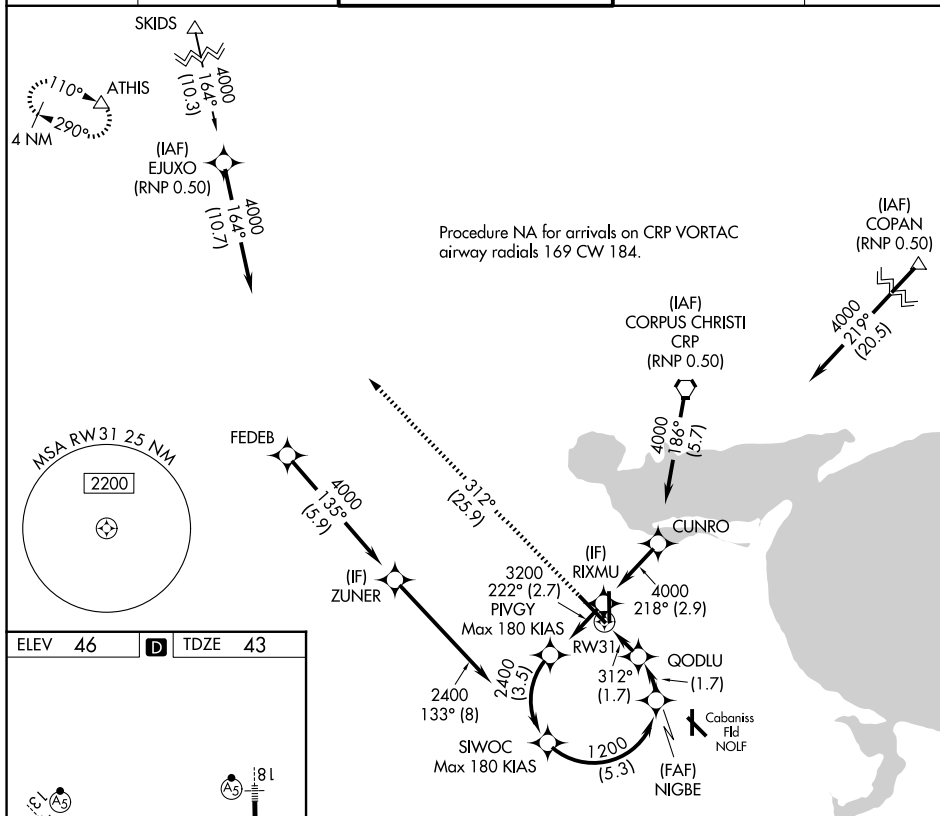

2000 ↑ tr 312°	ATHIS △	See planview for multiple IF locations.		
CATEGORY	A	B	C	D
RNP 0.14 DA*		303- $\frac{1}{2}$	260 (300- $\frac{1}{2}$)	
RNP 0.30 DA		384- $\frac{5}{8}$	341 (400- $\frac{5}{8}$)	

AUTHORIZATION REQUIRED

CORPUS CHRISTI, TEXAS
Amdt 1A 28NOV24

27°46'N-97°30'W

CORPUS CHRISTI INTL (CRP)
RNAV (RNP) Z RWY 31