
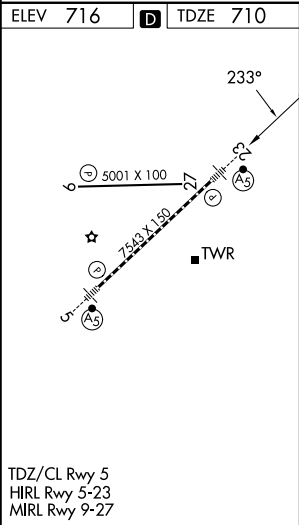


WAAS CH 65744 W23A	APP CRS 233°	Rwy Ldg 7543 TDZE 710 Apt Elev 716
--	------------------------	---

RNAV (GPS) RWY 23

WILLOW RUN (YIP)

RNP APCH - GPS.		MALSR 	MISSED APPROACH: Climb to 3000 direct ZAVEX and hold, continue climb-in-hold to 3000.
For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to ¾ SM, LNAV Cats C/D visibility to 1 SM.			
ATIS 127.425	DETROIT APP CON 118.95 284.0	WILLOW RUN TOWER 125.275 256.9	GND CON 119.975

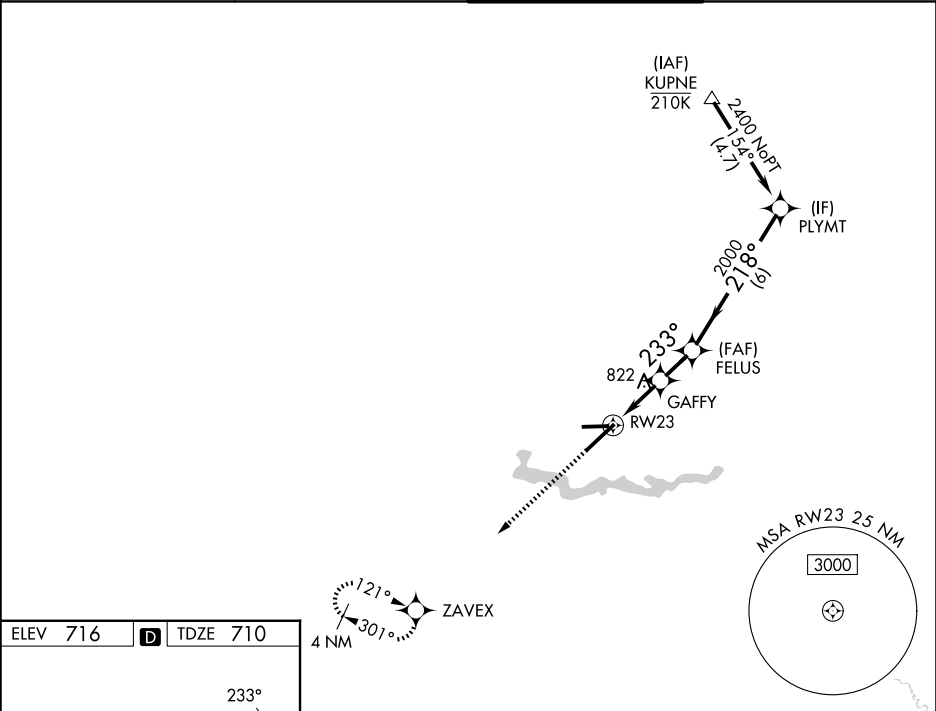

3000 ZAVEX		PLYMT	
1 NM to RW23		2400	
1 NM 1.3 NM 1.6 NM 6 NM		GP 3.00° TCH 57	
CATEGORY	A	B	C
LPV DA	910-½	200 (200-½)	
LNAV/VNAV DA	982-½	272 (300-½)	
LNAV MDA	1080-½ 370 (400-½)	1080-⅝ 370 (400-⅝)	
CIRCLING	1220-1 504 (600-1)	1220-1½ 504 (600-1½)	1400-2¼ 684 (700-2¼)

EC-1, 25 DEC 2025 to 22 JAN 2026

EC-1, 25 DEC 2025 to 22 JAN 2026