

LOC I-HFE	APP CRS	Rwy Ldg	10102
111.7	281°	TDZE	1174
		Apt Elev	1203

ILS RWY 28R (SA CAT I & II)

PITTSBURGH INTL (PIT)


From NASTY: Radar required for procedure entry.

MALSR

Simultaneous approach authorized. DME from MMJ DME. Simultaneous reception of I-HFE and MMJ DME required. SA CAT I: Requires specific OPSPEC, MSPEC, or LOA approval and use of HUD to DH. SA CAT II: Reduced lighting: requires specific OPSPEC, MSPEC, or LOA approval and use of autoland or HUD to touchdown.

MISSED APPROACH: Climb to 1800 then climbing right turn to 5000 direct EWC VOR/DME and hold.

D-ATIS	PITTSBURGH APP CON	PITTSBURGH TOWER	GND CON	CLNC DEL
ARR 127.25 DEP 135.9	123.95 360.8	128.3 291.7	SOUTH 121.9 348.6 NORTH 127.8 348.6	126.75 353.7

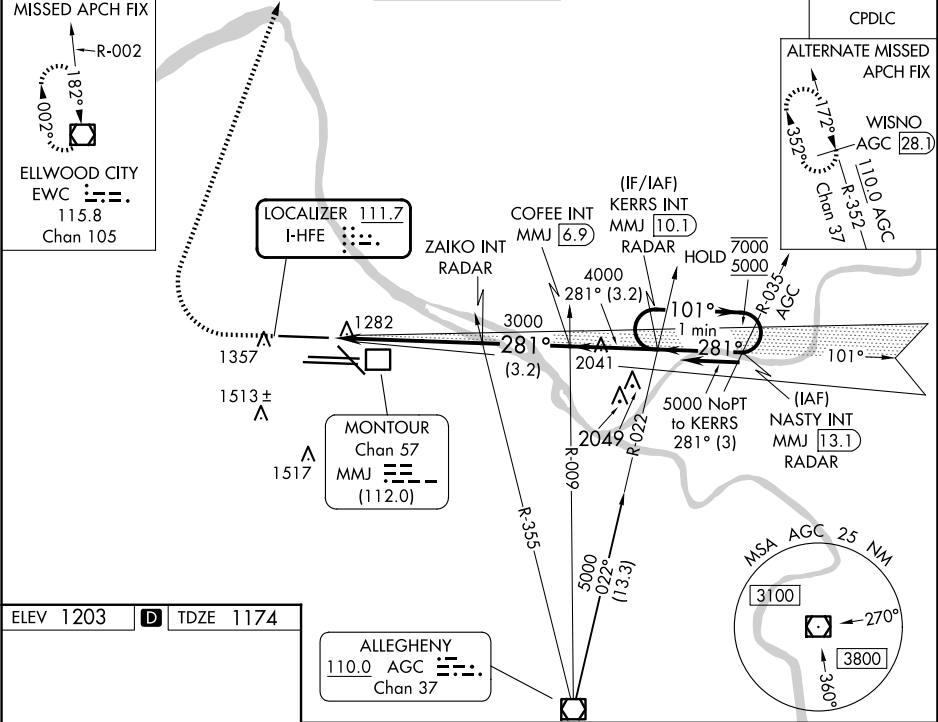

ELEV 1203 D TDZE 1174

VGSI and ILS glidepath not coincident (VGSI Angle 3.00/TCH 71).

One Minute Holding Pattern

GS 3.00° TCH 55

1800	5000	EWC
↑	↗	☐

REIL Rwy 10C
HIRL all Rwy
TDZ/CL Rwy 10L, 10R, 28L, 28R, 28C, and 32

5.6 NM	3.2 NM	3.2 NM		
111.7				
CATEGORY	A	B	C	D
S-ILS 28R	SA CAT I	RA 192/14	150	DA 1324
S-ILS 28R	SA CAT II	RA 116/12	100	DA 1274

SA CATEGORY I & II ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED