


APP CRS 036°	Rwy Ldg 10001 TDZE 633 Apt Elev 645
------------------------	--

RNAV (RNP) W RWY 3R
DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH.			ALSF-2 		MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAUGE and hold.	
 For uncompensated Baro-VNAV systems, procedure NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized.						
D-ATIS 133.675	DETROIT APP CON 125.15 284.0	METRO TOWER 118.4 317.725	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)		CLNC DEL 120.65	CPDLC

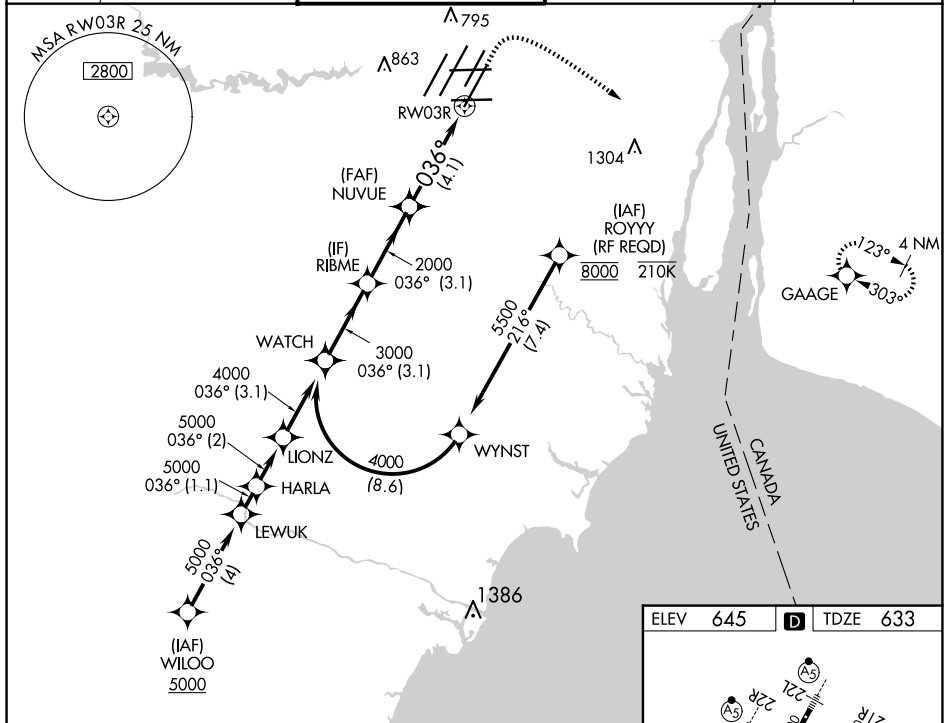

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 70).

WATCH

4000

036°

3000

RIBME

NUVUE

2000

2000

GP 3.00°
TCH 54

3.1 NM

3.1 NM

4.1 NM

RW03R

CATEGORY	A	B	C	D
RNP 0.30 DA	1021/35		388 (400-%)	

AUTHORIZATION REQUIRED

