

APP CRS

036°

Rwy Ldg

10000

TDZE

645


Apt Elev

645

RNAV (RNP) X RWY 4L

DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH.		ALS-F-2		MISSED APPROACH: Climb to 1100 then climbing left turn to 4000 direct DOHNT and hold.	
Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase RNP 0.30 DA all Cnts visibility to RVR 6000.					
D-ATIS 133.675	DETROIT APP CON 124.05 284.0	METRO TOWER 135.0 317.725	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)		CLNC DEL 120.65
				CPDLC	

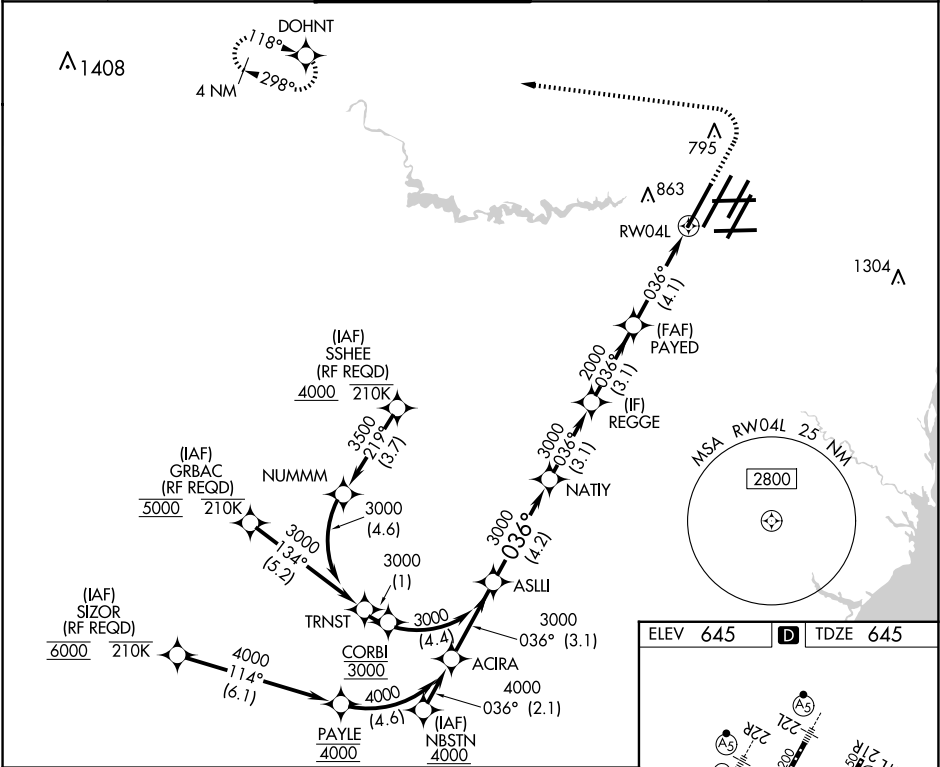

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 71).				1100	4000	DOHNT	
CATEGORY				A	B	C	D
RNP 0.15 DA				970/26		325 (400-½)	
RNP 0.30 DA				1058/40		413 (500-¾)	
AUTHORIZATION REQUIRED							
TDZ/CL Rwy 3R, 4L, 4R and 22R REIL Rwy 3L, 9L, 9R and 21R HIRL all runways							