

APP CRS	Rwy Ldg	11200
050°	TDZE	747
	Apt Elev	796

RNAV (RNP) Z RWY 5L

INDIANAPOLIS INTL (IND)

▼


For uncompensated Baro-VNAV systems, procedure NA below -18°C (0°F) or above 54°C (130°F). GPS required. For inop ALS, increase RNP 0.30 all Cats visibility to 1½ SM. Simultaneous approach authorized.

ALS-2

MISSED APPROACH:

Climbing left turn to 3000 direct KEADY and hold.

D-ATIS	INDIANAPOLIS APP CON	INDY TOWER	GND CON	CLNC DEL	CPDLC
134.25	128.175 317.8	120.9 251.1	121.9	128.75 251.1	

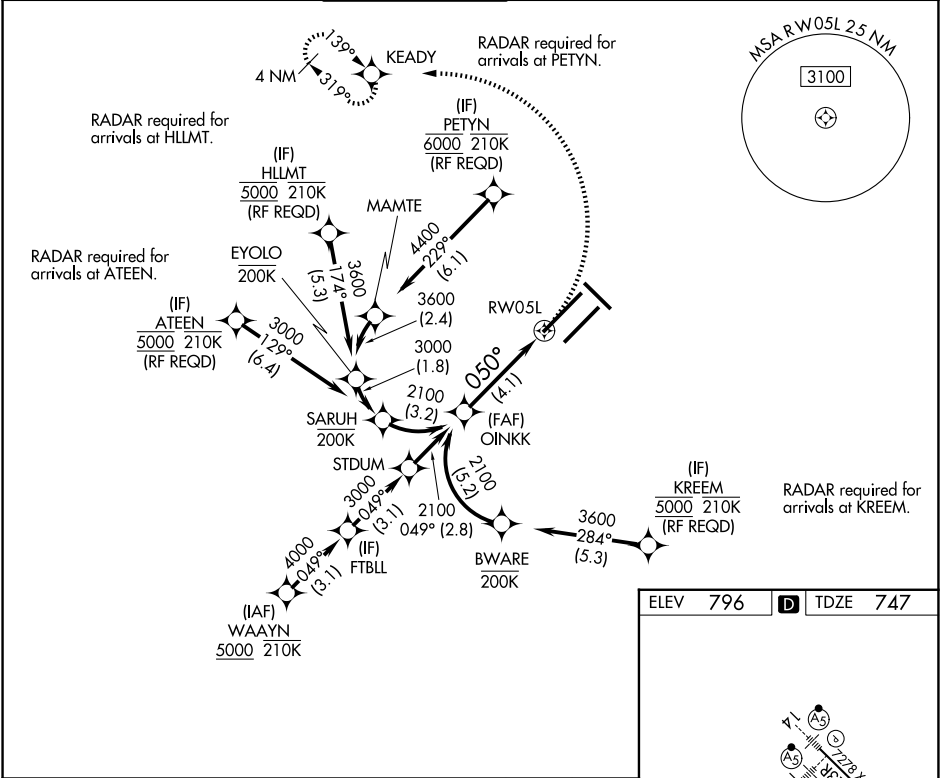

OINKK

2100

GP 3.00° TCH 53

050°

RW05L

4.1 NM

See planview for multiple IF locations.

3000

KEADY

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 74).

CATEGORY	A	B	C	D
RNP 0.30 DA		1197/60	450 (500-1¼)	

AUTHORIZATION REQUIRED

ELEV 796

D

TDZE 747

050°

0.5% DOWN

11200 X 150

10000 X 150

TWR

HIRL all Rwys

TDZ/CL Rwys 5L and 5R