

WAAS CH 70615 W27A	APP CRS 275°	Rwy Ldg TDZE Apt Elev	6520 974 981
--	------------------------	-----------------------------	---

RNAV (GPS) RWY 27L

OAKLAND COUNTY INTL (PTK)

RNP APCH.


▼

▲

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -16°C (4°F) or above 47°C (116°F).
Baro-VNAV and VDP NA when using Coleman A Young altimeter setting. Circling Rwy 9L, 36 NA at night. When local altimeter setting not received, use Coleman A Young Muni altimeter setting and increase LPV DA to 1279 feet, LNAV/VNAV DA to 1568 and all MDA 120 feet, increase LPV and LNAV/VNAV all cats visibility ½ SM, LNAV Cat C/D, and Circling Cat C/D visibility ½ SM.

MISSED APPROACH:
Climb to 3000 direct
EDESE and hold.

ATIS 125.025	DETROIT APP CON 132.35 284.0	PONTIAC TOWER ★ 120.5 (CTAF) 0	GND CON 121.9	UNICOM 122.95
------------------------	--	--	-------------------------	-------------------------

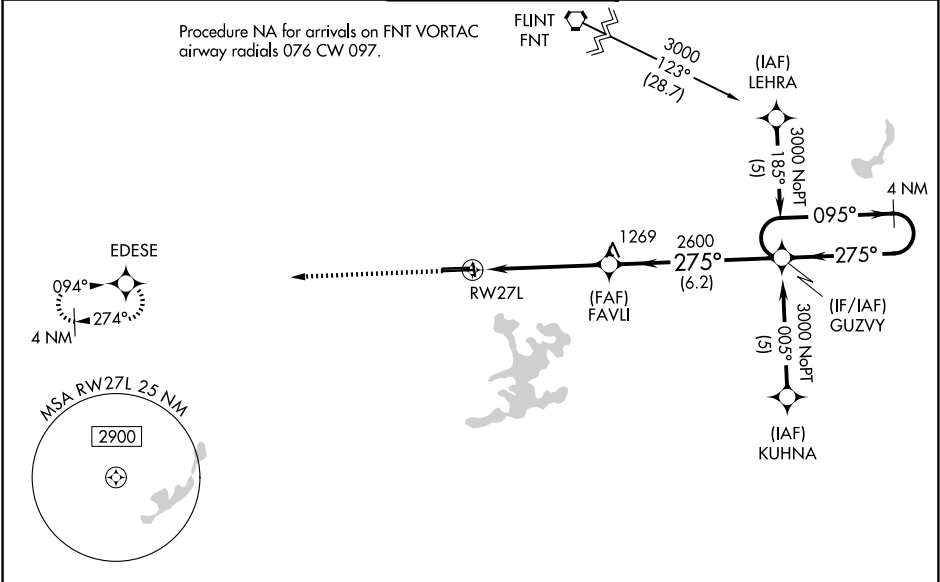

ELEV 981

D

TDZE 974

3000

EDESE

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 42).

4 NM Holding Pattern

*LNAV only.

*1.4 NM to RWY 27L

FAVLI

2600

275°

095°

3000

GP 3.00°
TCH 47

275°

2600

1.4

3.5 NM

6.2 NM

CATEGORY	A	B	C	D
LPV DA	1174-3⁄4 200 (200-3⁄4)			
LNAV/VNAV DA	1463-13⁄4 489 (500-13⁄4)			
LNAV MDA	1460-1	486 (500-1)	1460-1 1⁄4 486 (500-1 1⁄4)	1460-1 1⁄2 486 (500-1 1⁄2)
CIRCLING	1500-1 519 (600-1)	1540-1 559 (600-1)	1640-1 3⁄4 659 (700-1 3⁄4)	1640-2 659 (700-2)