


APP CRS	Rwy Ldg	7701
137°	TDZE	27
	Apt Elev	29

RNAV (RNP) Y RWY 14
JACKSONVILLE INTL (JAX)

▼ For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required. For inoperative MALSR, increase RNP 0.30 all Cats	MALSR	MISSED APPROACH: Climb to 500 then climbing left turn to 2000 direct YEJWO and hold.
--	-------	--

D-ATIS 125.85	JACKSONVILLE APP CON 119.0 269.9	JACKSONVILLE TOWER 118.3 317.7	GND CON 121.9 348.6
------------------	-------------------------------------	-----------------------------------	------------------------

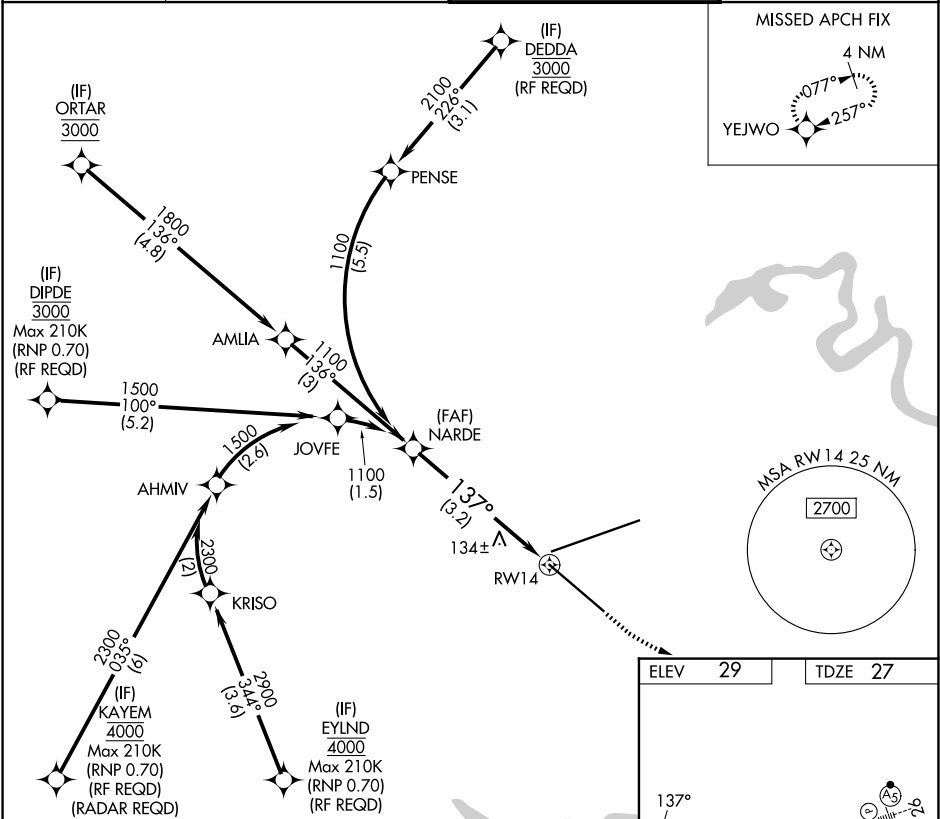

VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 70).					500	2000	YEJWO
NARDE							
1100							
GP 3.00° TCH 54							
See planview for multiple IF locations.							
3.2 NM							
CATEGORY	A	B	C	D			
RNP 0.30 DA	389-1 362 (400-1)						
AUTHORIZATION REQUIRED							
REIL Rwy 32 TDZL/RCLS Rwys 8, 14, and 26 HIRL Rwys 8-26 and 14-32							

SE-3, 22 JAN 2026 to 19 FEB 2026

SE-3, 22 JAN 2026 to 19 FEB 2026