

APP CRS	Rwy Ldg	7701
317°	TDZE	24
	Apt Elev	29


RNAV (RNP) Y RWY 32

JACKSONVILLE INTL (JAX)

For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required.

MISSED APPROACH: Climb to 2000 on track 317° to OSBAJ and hold.

D-ATIS 125.85	JACKSONVILLE APP CON 119.0 269.9	JACKSONVILLE TOWER 118.3 317.7	GND CON 121.9 348.6
------------------	-------------------------------------	-----------------------------------	------------------------

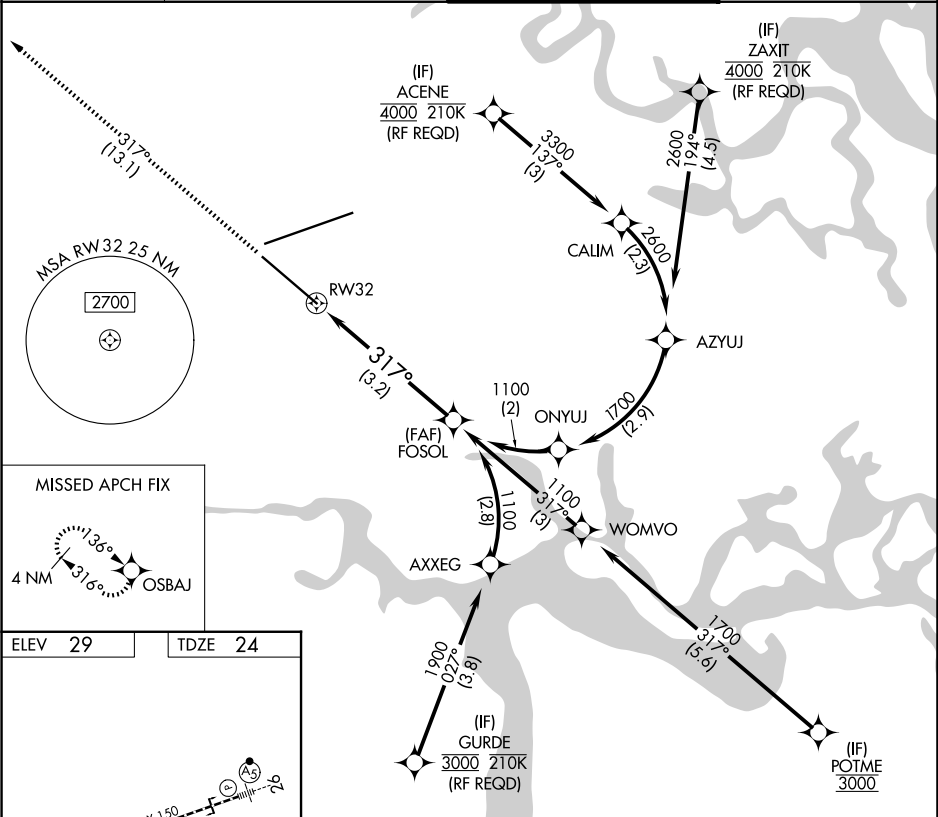

ELEV 29

TDZE 24

REIL Rwy 32
TDZL/RCLS Rws 8, 14, and 26
HIRL Rws 8-26 and 14-32

2000

OSBAJ

tr 317°

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 67).

FOSOL

1100

GP 3.00°

TCH 50

RW32

317°

See planview for multiple IF locations.

3.2 NM

CATEGORY	A	B	C	D
RNP 0.11 DA		359-1 1/8	334 (400-1 1/8)	
RNP 0.30 DA		423-1 3/8	399 (400-1 3/8)	

AUTHORIZATION REQUIRED