


LOC/DME I-RGS 110.15 Chan 38(Y)	APP CRS 183°	Rwy Ldg TDZE 744 Apt Elev 748	9000
---	------------------------	---	-------------


ILS RWY 18R (SA CAT I)

CHARLOTTE/DOUGLAS INTL (CLT)

RADAR required for procedure entry. DME or RADAR required. Simultaneous approach authorized. Requires specific OPSPEC, MSPEC or LOA approval and use of HUD to DH.		ALSF-2 	MISSED APPROACH: Climb to 1200 then climbing right turn to 4000 on CLT VOR/DME R-250 to STULL INT/CLT 13 DME and hold, continue climb-in-hold to 4000.
D-ATIS 121.15	CHARLOTTE APP CON 128.325 (001°-119°) 257.2 (180°-359°) 120.05 (120°-295°) 307.8 (360°-179°) 134.75 (296°-360°)		CHARLOTTE TOWER 118.1 257.8 (Rwys 18L-36R) 126.4 257.8 (Rwy 18C-36C) 133.35 257.8 (Rwy 18R-36L)
			GND CON 121.8 348.6 (W) 121.9 348.6 (E)

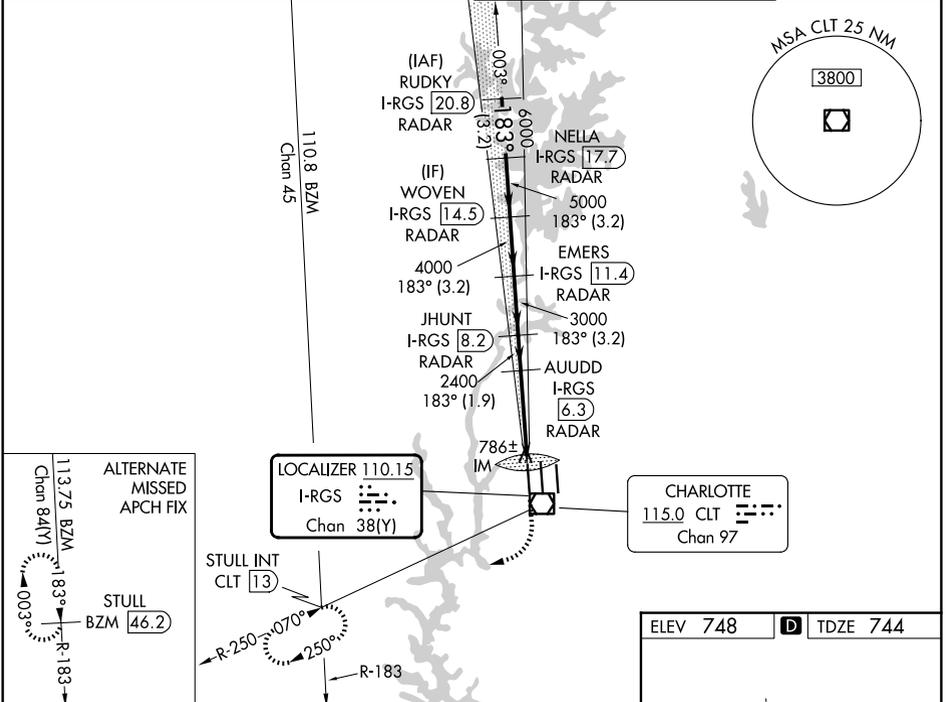

VGSi and ILS glidepath not coincident (VGSi Angle 2.80/TCH 65).				
RUDKY I-RGS 20.8 RADAR 7000 GS 3.00° TCH 55	NELLA I-RGS 17.7 RADAR 5000	WOVEN I-RGS 14.5 RADAR 4000	EMERS I-RGS 11.4 RADAR 3000	JHUNT I-RGS 8.2 RADAR 2400
AUUDD I-RGS 6.3 RADAR 2400				
STULL INT 1200 4000 CLT R-250				
IM 2400 5 NM 1.078'				
CATEGORY	A	B	C	D
S-ILS 18R	RA 228/14 150 DA 894			

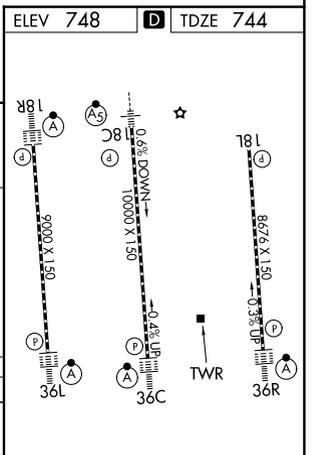

SA CATEGORY I ILS SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED

HIRL all Rwys
REIL Rwys 18L and 23
TDZ/CL Rwys 18R, 36L, 36C and 36R

SE-2, 19 FEB 2026 to 19 MAR 2026

SE-2, 19 FEB 2026 to 19 MAR 2026