WAAS	APP CRS	Rwy Ldg	10001
CH 61304	036°	TDZE	633
W03A		Apt Elev	645

RNAV (GPS) Z RWY 3R

DETROIT METRO WAYNE COUNTY (DTW)

RNP APCH.

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized. LNAV procedure NA during simultaneous operations. Use of FD or AP required during simultaneous operations.

ALSF-2

MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAAGE and hold, continue climb-in-hold to 4000.

D-ATIS	DETROIT APP CON	METRO TOWER	GND CON
133.675	125.15 284.0	118.4 317.725	121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)

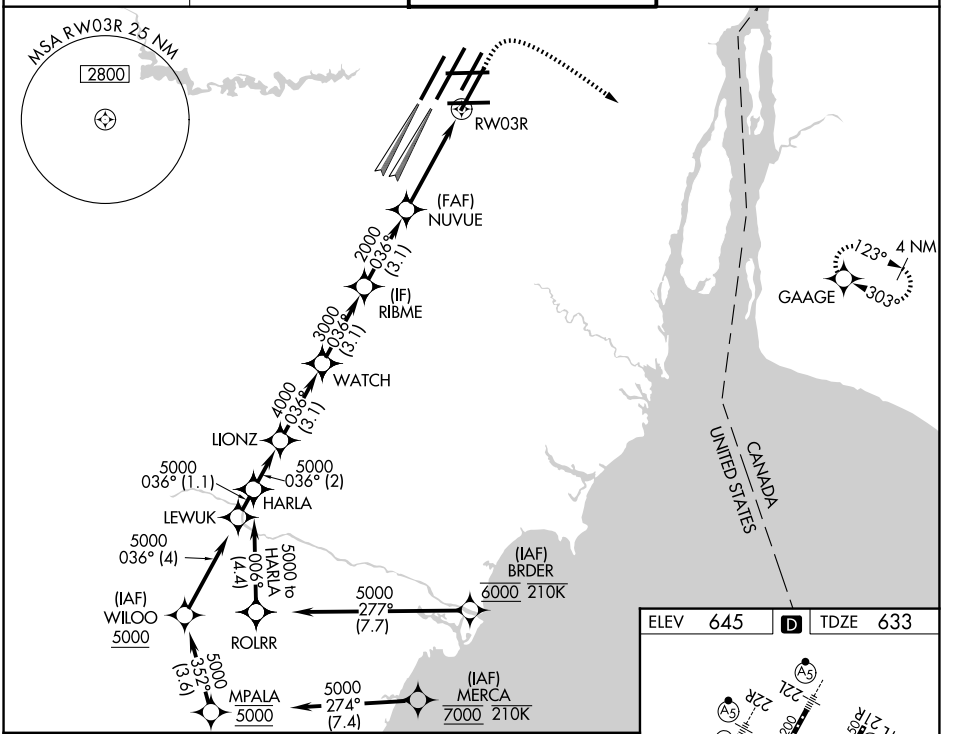

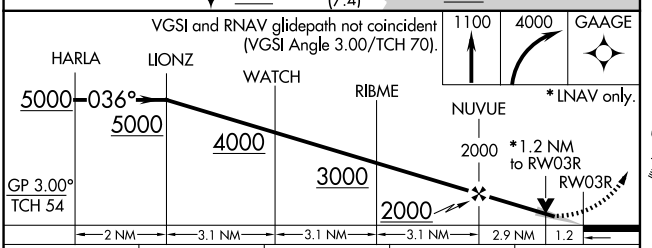

CATEGORY	A	B	C	D
LPV DA	833/18 200 (200-½)			
LNAV/VNAV DA	1013/35 380 (400-⅝)			
LNAV MDA	1080/24 447 (500-½)		1080/45 447 (500-⅞)	
CIRCLING	1180-1 535 (600-1)		1180-1½ 535 (600-1½)	1240-2 595 (600-2)

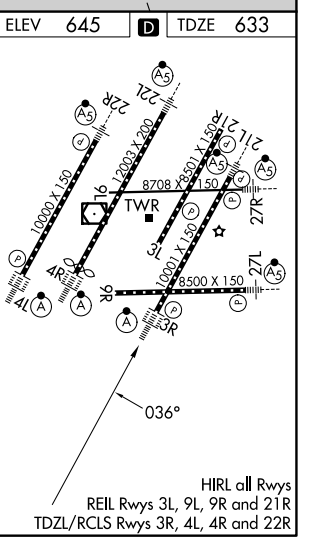

EC-1, 11 JUN 2026 to 09 JUL 2026
EC-1, 11 JUN 2026 to 09 JUL 2026