

LOC/DME I-TLH <b>110.3</b> Chan 40	APP CRS <b>004°</b>	Rwy Ldg <b>7000</b> TDZE <b>62</b> Apt Elev <b>83</b>
--	------------------------	---

# ILS Z or LOC Z RWY 36

TALLAHASSEE INTL (TLH)

DME required. RADAR required for procedure entry at CVILL.


ASR

\* RVR 1800 authorized with use of FD or AP or HUD to DA.


MALSR

MISSED APPROACH: Climb to 4000 direct SZW VORTAC and hold, continue climb-in-hold to 4000.

ATIS <b>119.45 239.25</b>	TALLAHASSEE APP CON★ <b>135.8 317.4</b>	TALLAHASSEE TOWER★ <b>118.7 (CTAF) 0 257.8</b>	GND CON <b>121.9 348.6</b>	UNICOM <b>123.075</b>
------------------------------	--	---	-------------------------------	--------------------------

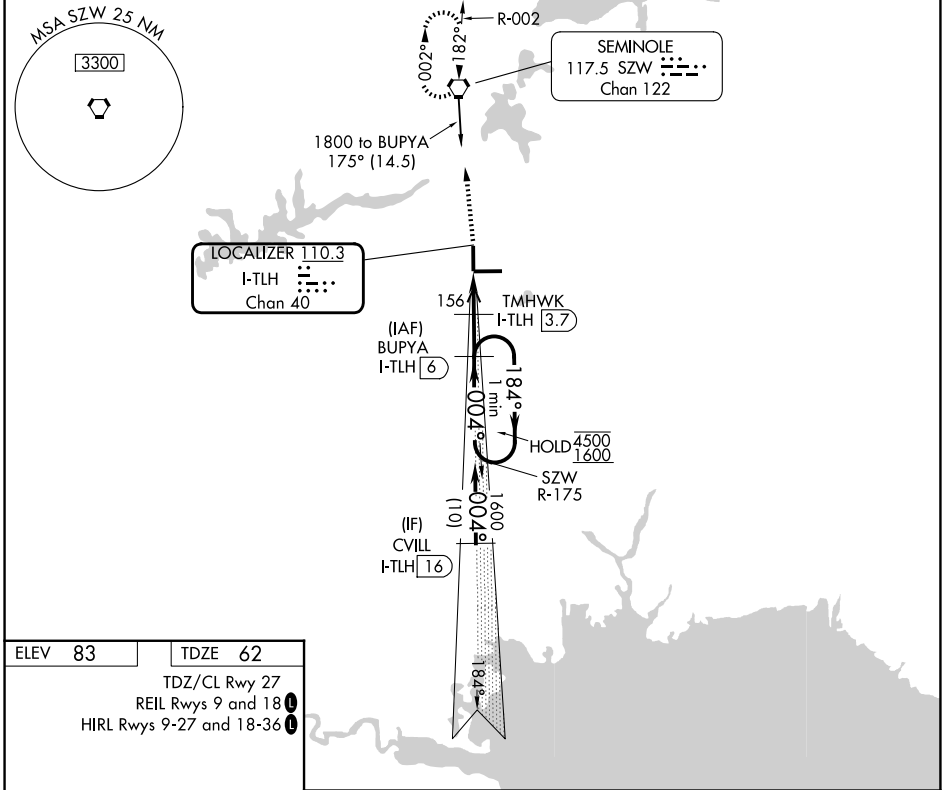

ELEV 83	TDZE 62
TDZ/CL Rwy 27	
REIL Rwy 9 and 18	
HIRL Rwy 9-27 and 18-36	

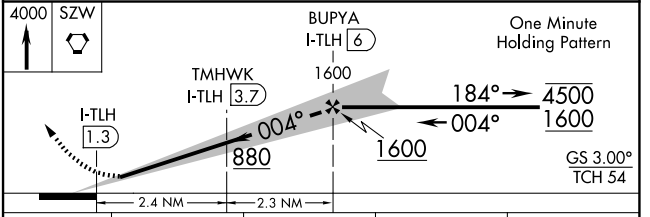

CATEGORY	A	B	C	D
S-ILS 36 *	262/24		200 (200-½)	
S-LOC 36	460/24	398 (400-½)	460/35	398 (400-¾)
CIRCLING	580-1 497 (500-1)	600-1 517 (600-1)	640-1½ 557 (600-1½)	800-2¼ 717 (800-2¼)

SE-3, 11 JUN 2026 to 09 JUL 2026

SE-3, 11 JUN 2026 to 09 JUL 2026