

APP CRS <b>137°</b>	Rwy Ldg TDZE Apt Elev	<b>7701</b> <b>27</b> <b>29</b>
------------------------	-----------------------------	---------------------------------------

# RNAV (RNP) Y RWY 14


JACKSONVILLE INTL (JAX)

For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required. For inoperative MALSR, increase RNP 0.30 all Cats

MALSR

MISSED APPROACH: Climb to 500 then climbing left turn to 2000 direct YEJWO and hold.

D-ATIS <b>125.85</b>	JACKSONVILLE APP CON <b>119.0 269.9</b>	JACKSONVILLE TOWER <b>118.3 317.7</b>	GND CON <b>121.9 348.6</b>
-------------------------	--	--	-------------------------------

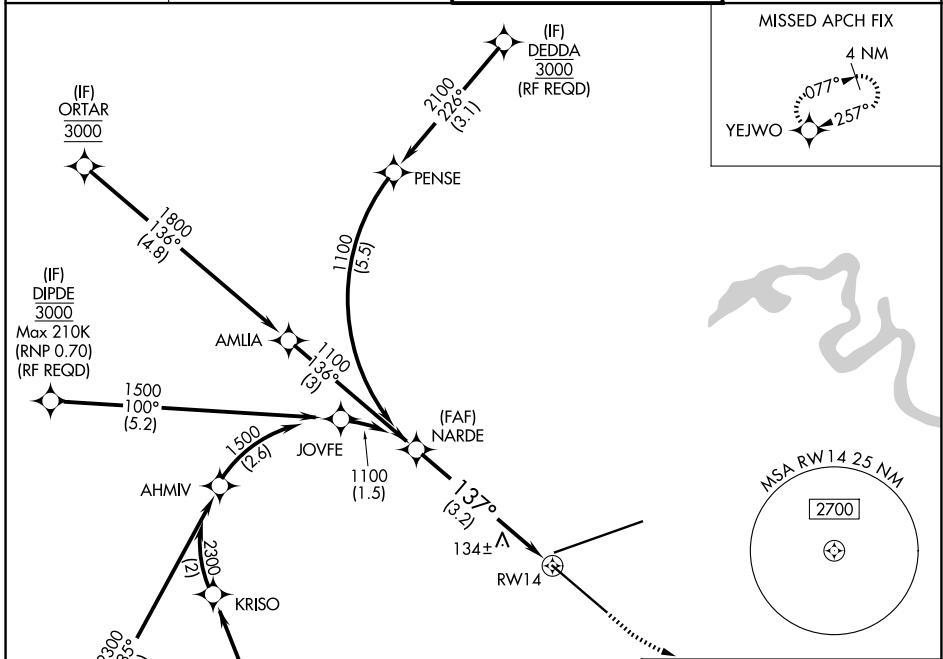

ELEV 29	TDZE 27
---------	---------



VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 70).

NARDE 1100

GP 3.00° TCH 54

See planview for multiple IF locations.

3.2 NM

CATEGORY	A	B	C	D
RNP 0.30 DA		389-1	362 (400-1)	

## AUTHORIZATION REQUIRED

REIL Rwy 32  
TDZL/RCLS Rwy 8, 14, and 26  
HIRL Rwy 8-26 and 14-32

SE-3, 11 JUN 2026 to 09 JUL 2026

SE-3, 11 JUN 2026 to 09 JUL 2026