
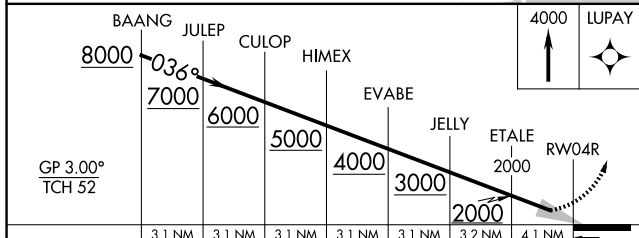


WAAS CH 87139 W04B	APP CRS 036°	Rwy Ldg 11494 TDZE 640 Apt Elev 645
--	------------------------	--

RNP APCH.

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -19°C or above 54°C . Simultaneous approach authorized. Use of FD or AP required during simultaneous operations. Dual VHF comm required. See additional requirements on AAUP.	ALSF-2 A	MISSED APPROACH: Climb to 4000 direct LUPAY and hold.
--	--	---

D-ATIS 133.675	DETROIT APP CON 124.05 284.0	METRO TOWER 128.125 317.725 PRM 135.775	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)
--------------------------	--	---	---

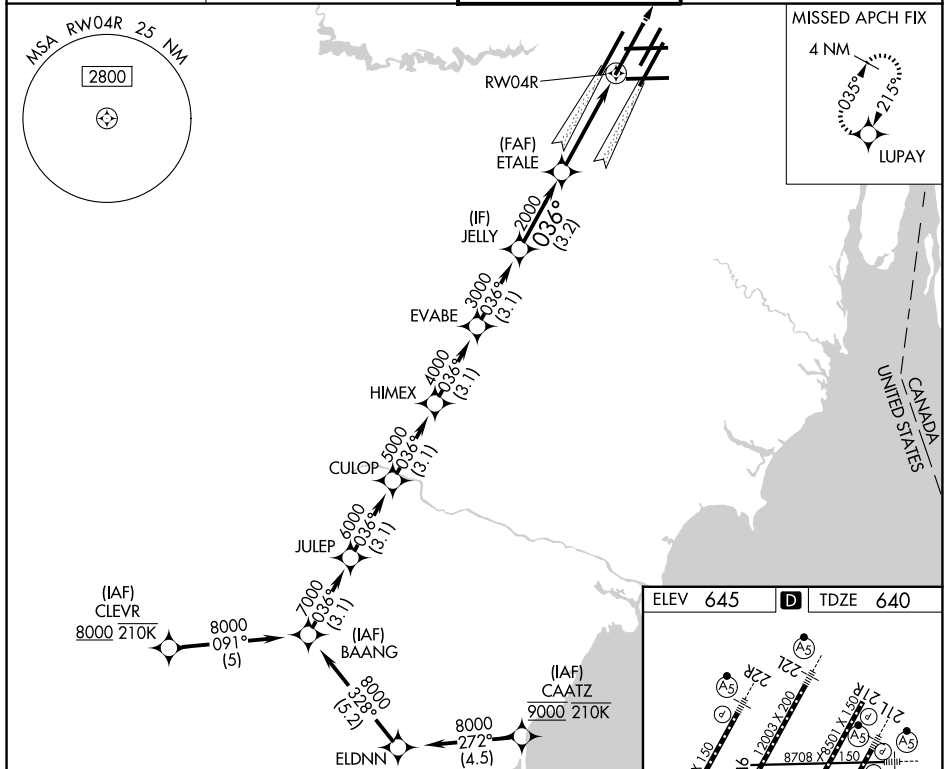

CATEGORY	A	B	C	D
LPV DA		840/18	200 (200-½)	
LNAV/VNAV DA		1021/35	381 (400-¾)	

