


APP CRS 036°	Rwy Ldg 10001 TDZE 633 Apt Elev 645
------------------------	--

RNAV (RNP) W RWY 3R
DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH.  For uncompensated Baro-VNAV systems, procedure NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized.		ALSF-2 	MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAAGE and hold.
D-ATIS 133.675	DETROIT APP CON 125.15 284.0	METRO TOWER 118.4 317.725	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)

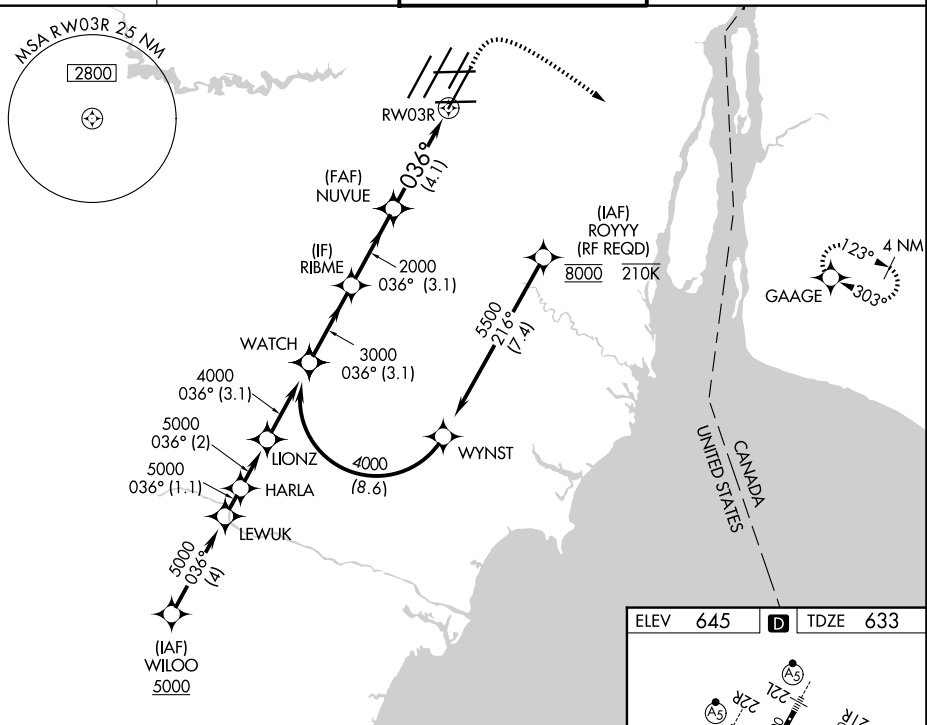

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 70).

CATEGORY	A	B	C	D
RNP 0.30 DA	1021/35		388 (400- $\frac{2}{3}$)	

AUTHORIZATION REQUIRED

