

APP CRS  
**036°**

Rwy Ldg  
TDZE **633**

Apt Elev  
**645**

**RNAV (RNP) X RWY 3R**

DETROIT METRO WAYNE COUNTY (DTW)


RNP AR APCH.

Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C.

ALSIF-2

MISSED APPROACH: Climb to 1100 then climbing right turn to 4000 direct GAAGE and hold.

|                          |                                        |                                     |                                                                             |
|--------------------------|----------------------------------------|-------------------------------------|-----------------------------------------------------------------------------|
| D-ATIS<br><b>133.675</b> | DETROIT APP CON<br><b>125.15 284.0</b> | METRO TOWER<br><b>118.4 317.725</b> | GND CON<br><b>121.8 (NW) 119.45 (NE)</b><br><b>132.725 (SW) 119.25 (SE)</b> |
|--------------------------|----------------------------------------|-------------------------------------|-----------------------------------------------------------------------------|

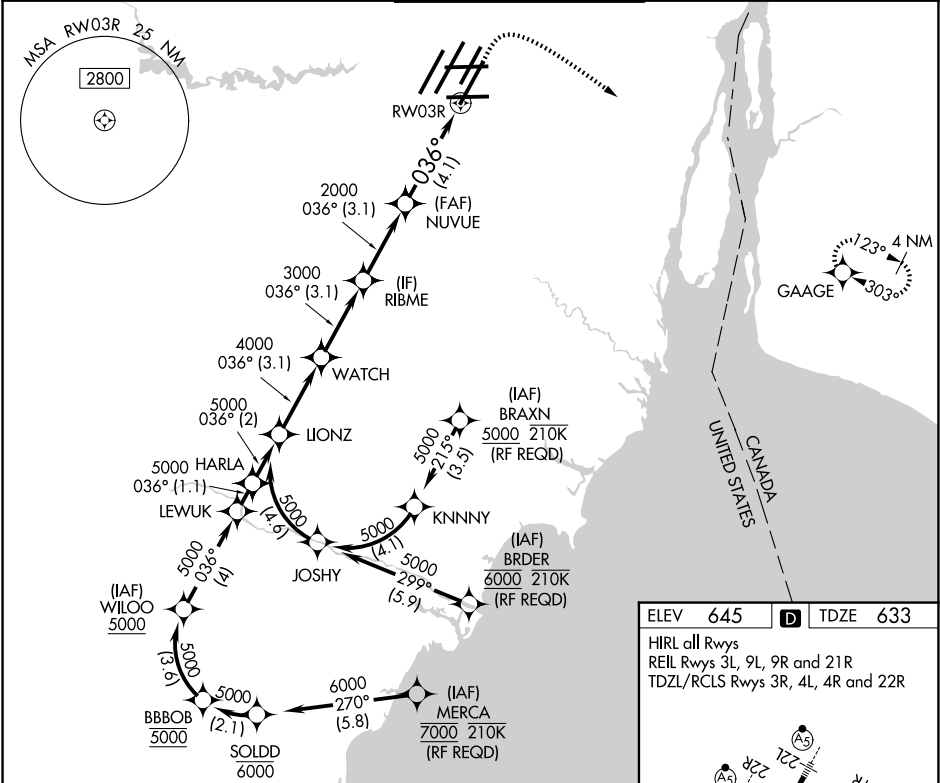

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 70).

1100

4000

GAAGE

LIONZ

WATCH

RIBME

NUVUE

RW03R

GP 3.00°

TCH 54

3.1 NM

3.1 NM

3.1 NM

4.1 NM

|             |                     |   |   |   |
|-------------|---------------------|---|---|---|
| CATEGORY    | A                   | B | C | D |
| RNP 0.30 DA | 1021/35 388 (400-%) |   |   |   |

**AUTHORIZATION REQUIRED**

