

APP CRS
222°

Rwy Ldg
TDZE
Apt Elev

12020
3950
3962

RNAV (RNP) Z RWY 22
EL PASO INTL (ELP)

RNP AR APCH.


▼ For uncompensated Baro-VNAV systems, procedure NA below -8°C or above 54°C. For inop ALS, increase RNP 0.10 all Cats visibility to RVR 4000 and RNP 0.30 all Cats visibility to RVR 4500.

ASR

MALSR

MISSED APPROACH: Climb to 4400 then climbing left turn to 7500 direct FABAN and hold.

D-ATIS 120.0 254.3	EL PASO APP CON 124.25 298.85	EL PASO TOWER 118.3 239.275	GND CON 121.9 348.6
------------------------------	---	---------------------------------------	-------------------------------

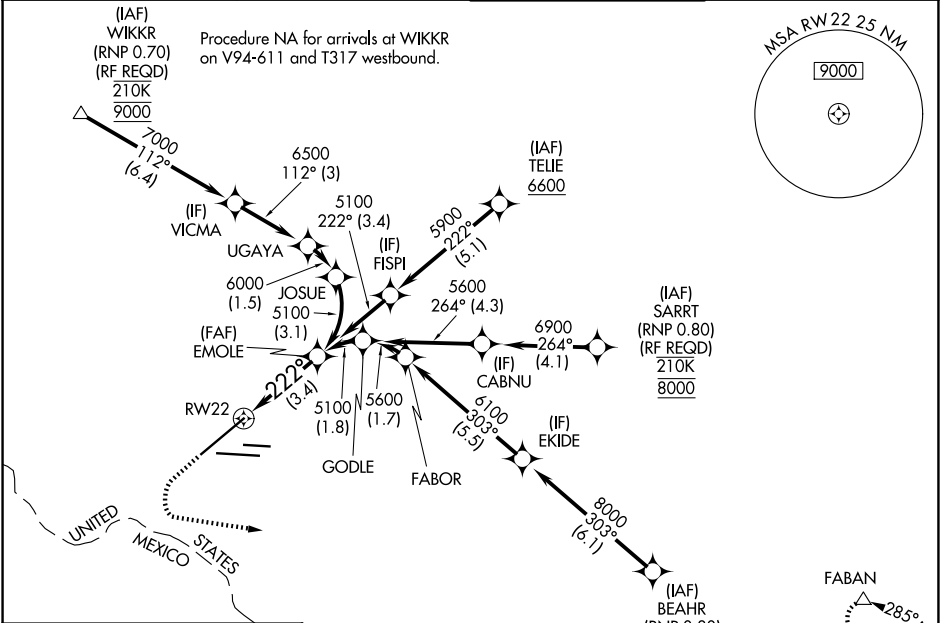

ELEV 3962

D

TDZE 3950

12020 X 150
5499 X 75
9025 X 150
TWR

222°
0.3% DOWN
0.5% UP
0.3% DOWN

MIRL Rwy 8L-26R

REIL Rws 4 and 8R

HIRL Rws 4-22 and 8R-26L

4400

7500

FABAN

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 70).

RW22

EMOLE 5100

GP 3.00° TCH 55

See planview for multiple IF locations.

3.4 NM

CATEGORY	A	B	C	D
RNP 0.10 DA		4200/24	250 (300-½)	
RNP 0.30 DA		4270/27	320 (400-⅝)	

AUTHORIZATION REQUIRED