

APP CRS
005°

Rwy Ldg
TDZE
Apt Elev

9001
90
96

RNAV (RNP) Z RWY 35R

ORLANDO INTL (MCO)


RNP AR APCH - GPS. Authorization required. From CAVMN: RF.

Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below 2°C or above 54°C. For inop ALS, increase RNP 0.13 all Cats visibility to RVR 4500.

ALS-2

MISSED APPROACH: Climb to 500 then climbing right turn to 3000 direct PRESK and hold, continue climb-in-hold to 3000.

D-ATIS 121.25	ORLANDO APP CON 124.8 307.0	ORLANDO TOWER 118.45 253.5 (17L/35R, 17R/35L) 124.3 253.5 (18L/36R, 18R/36L)	GND CON 126.4 (E) 121.8 (W)
------------------	--------------------------------	--	-----------------------------------

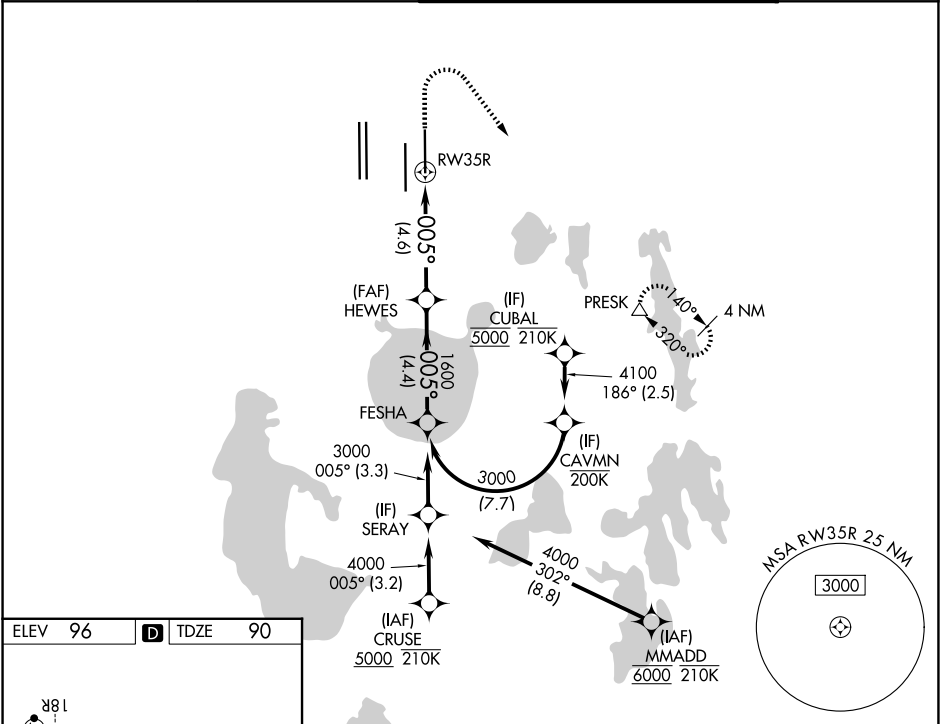

ELEV 96

D

TDZE 90

HIRL all Rwys
REIL Rwy 36L
TDZL/RCLS Rwys 17L/R,
18R, 35L/R, and 36R

500

3000

PRESK

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 73).

See planview for multiple IF locations.

CATEGORY	A	B	C	D
RNP 0.13 DA	360/24	270 (300-½)		
RNP 0.30 DA	430/26	340 (400-½)		

AUTHORIZATION REQUIRED