



LOC/DME I-TQR 108.7 Chan 24	APP CRS 233°	Rwy Ldg TDZE Apt Elev	8002 661 668
--	------------------------	-----------------------------	---

ILS or LOC RWY 23
MBS INTL (MBS)

DME or RADAR required. RADAR required for procedure entry.	MALSR	MISSED APPROACH: Climb to 2500 on MBS VOR/DME R-230 to KWORD/MBS 6.1 DME/RADAR and hold.
*RVR 1800 authorized with use of FD or AP or HUD to DA.		

ATIS 125.925	GREAT LAKES APP CON★ 126.45 235.625	SAGINAW TOWER★ 120.1 (CTAF) 0 257.7	GND CON 121.7	UNICOM 122.95
------------------------	---	---	-------------------------	-------------------------

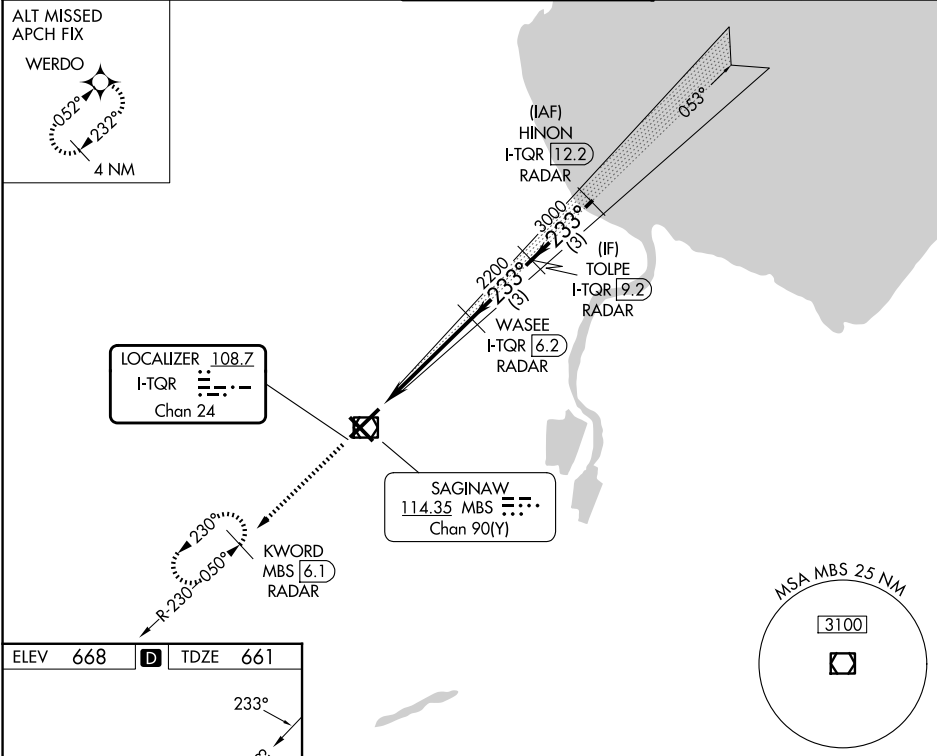

					
REIL Rwys 14 and 32 L					
HIRL Rwys 5-23 and 14-32 L					
FAF to MAP 4.7 NM					
Knots	60	90	120	150	180
Min:Sec	4:42	3:08	2:21	1:53	1:34

2500	MBS R-230	KWORD MBS 6.1 RADAR	WASEE I-TQR 6.2 RADAR	TOLPE I-TQR 9.2 RADAR
CATEGORY A B C D				
S-ILS 23 *	861/24 200 (200-1/2)			
S-LOC 23	1060/24 399 (400-1/2)		1060/35 399 (400-5/8)	
CIRCLING	1080-1 412 (500-1)	1120-1 452 (500-1)	1240-1 1/2 572 (600-1 1/2)	1240-2 572 (600-2)