


APP CRS	Rwy Ldg	8605
168°	TDZE	27
	Apt Elev	27

RNAV (RNP) Z RWY 17L

SACRAMENTO INTL (SMF)

RNP AR APCH-GPS.	MALSR	MISSED APPROACH: Climb to 500 then right turn to 3000 direct GRIME and hold. *Missed approach requires minimum climb of 290 feet per NM to 3000. #Missed approach requires minimum climb of 300 feet per NM to 3000.
For uncompensated Baro-VNAV systems, procedure NA below -2°C or above 54°C. For inop ALS, increase RNP 0.12 all Cats visibility to RVR 4000; increase RNP 0.30 all Cats visibility to RVR 4500.		

D-ATIS	NORCAL APP CON	CAPITOL TOWER	GND CON
126.75	125.4 259.1 (W-NE) 125.25 257.9 (SW) 127.4 317.5 (E-SE)	125.7 256.7	121.7 256.7

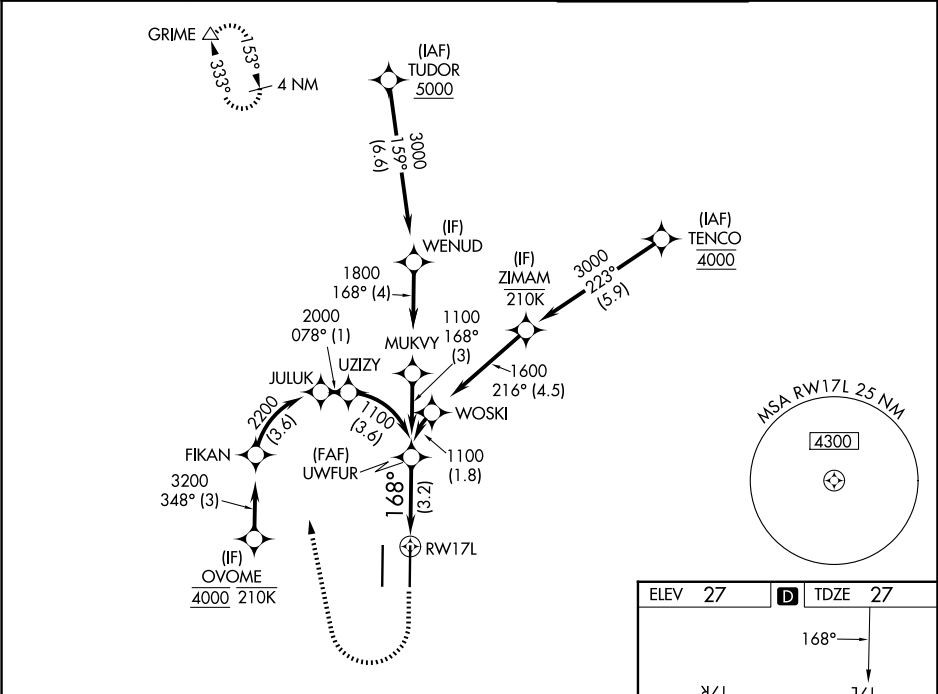

500

3000

GRIME

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 64).

RW17L

1100

168°

See planview for multiple IF locations.

GP 3.00° TCH 55

CATEGORY

A

B

C

D

RNP 0.12 DA#

277/24

250 (300-½)

RNP 0.30 DA*

339/24

312 (400-½)

AUTHORIZATION REQUIRED

