
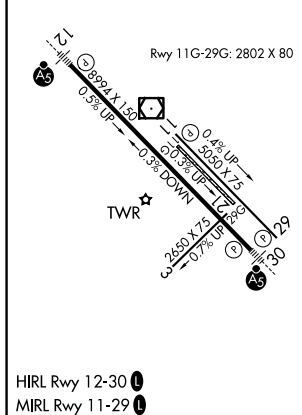


LOC I-BZN 109.3	APP CRS 123°	Rwy Ldg 8994 TDZE 4443 Apt Elev 4473
---------------------------	------------------------	---

ILS Y RWY 12 (SA CAT II)
BOZEMAN YELLOWSTONE INTL (BZN)

  -21°C	DME from BZN VOR/DME. DME use requires simultaneous reception of I-BZN and BZN DME. Requires specific OPSPEC, MSPEC, or LOA approval. Procedure NA when tower closed.	MALSR 	MISSED APPROACH: Climb to 5200 then climbing right turn to 9000 on heading 250° and on BZN VOR/DME R-223 to BRGR INT/BZN VOR/DME 15 DME and hold, Continue climb-in-hold to 9000.
---	---	--	---

ATIS 135.425	BIG SKY APP CON★ 118.975 226.675	BOZEMAN TOWER★ 118.2 (CTAF) 0	GND CON 121.8	UNICOM 122.95
------------------------	--	---	-------------------------	-------------------------

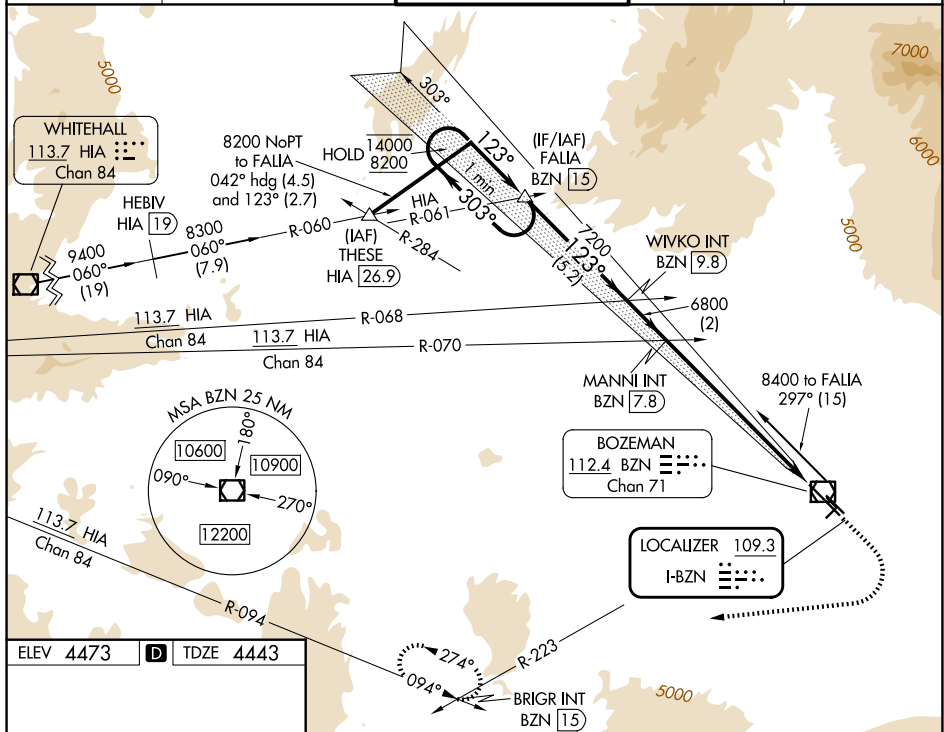

One Minute Holding Pattern		FALIA BZN (15)	WIVKO INT BZN (9.8)	MANNI INT BZN (7.8)	5200 ↑ 9000 hdg 250°	BZN R-223	BRIGR INT
14000 ← 303° 8200 → 123°							
CATEGORY	A	B	C	D			
S-ILS 12	RA 120/12 100 DA 4543						
SA CATEGORY II ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED							