
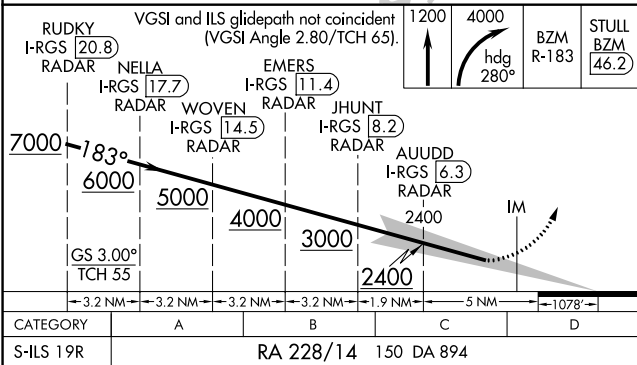


LOC/DME I-RGS 110.15 Chan 38 (Y)	APP CRS 183°	Rwy Ldg TDZE 744 Apt Elev 748	ILS RWY 19R (SA CAT I) CHARLOTTE/DOUGLAS INTL (CLT)
--	------------------------	---	--

DME or RADAR required. RADAR required for procedure entry.	ALSF-2 	MISSED APPROACH: Climb to 1200 then climbing right turn to 4000 on heading 280° and on BZM VOR/DME R-183 to STULL/BZM 46.2 DME/RADAR and hold, continue climb-in-hold to 4000.
Simultaneous approach authorized. Requires specific OPSPEC, MSPEC, or LOA approval.		

D-ATIS 121.15	CHARLOTTE APP CON 128.325 (001°-119°) 120.05 (120°-295°) 134.75 (296°-360°)	257.2 (180°-359°) 307.8 (360°-179°)	CHARLOTTE TOWER 118.1 257.8 (18L-36R) 126.4 257.8 (1R-19L) 133.35 257.8 (1L-19R)	GND CON 121.8 348.6 (W) 121.9 348.6 (E)
-------------------------	---	--	---	---

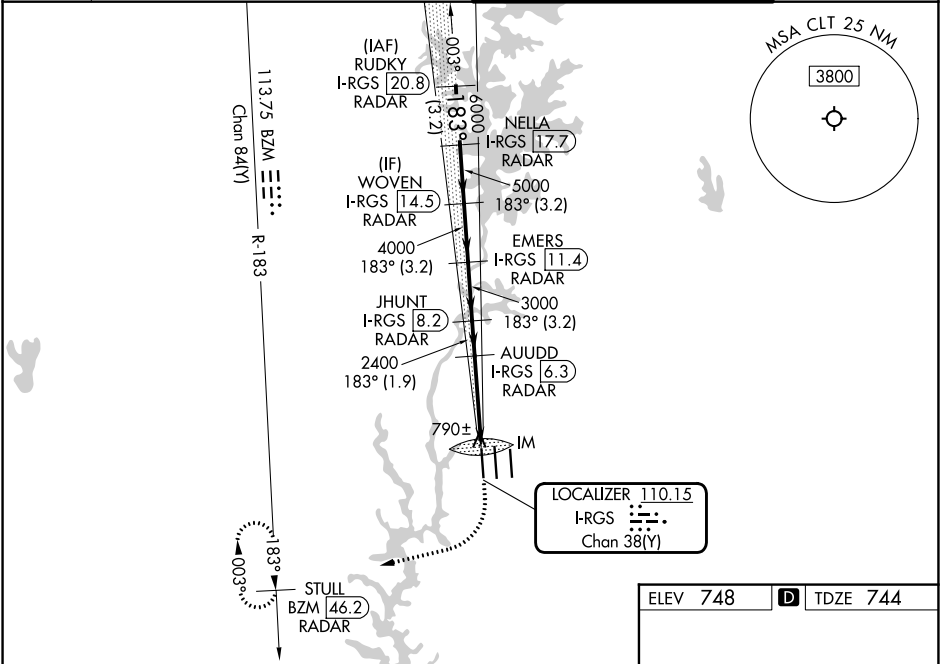

SA CATEGORY I ILS SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED		HIRL all Rwys REIL Rwy 18L TDZL/RCLS Rwys 11L, 1R, 19R, and 36R
---	--	---