


LOC/DME I-AQI 111.75 Chan 54 (Y)	APP CRS 101°	Rwy Ldg 10114 TDZE 809 Apt Elev 815
--	------------------------	--

ILS RWY 10R (SA CAT I & II)
JOHN GLENN COLUMBUS INTL (CMH)

ADF required. DME or RADAR required. Simultaneous approach authorized. SA CAT I, SA CAT II: Requires specific OPSPEC, MSPEC, or LOA approval.	MALSR 	MISSED APPROACH: Climb to 1400 then climbing right turn to 3000 direct BU LOM and hold.
---	--	---

D-ATIS 124.6	COLUMBUS APP CON 125.95 371.975	COLUMBUS TOWER 132.7 257.8	GND CON 121.9 348.6
------------------------	---	--------------------------------------	-------------------------------

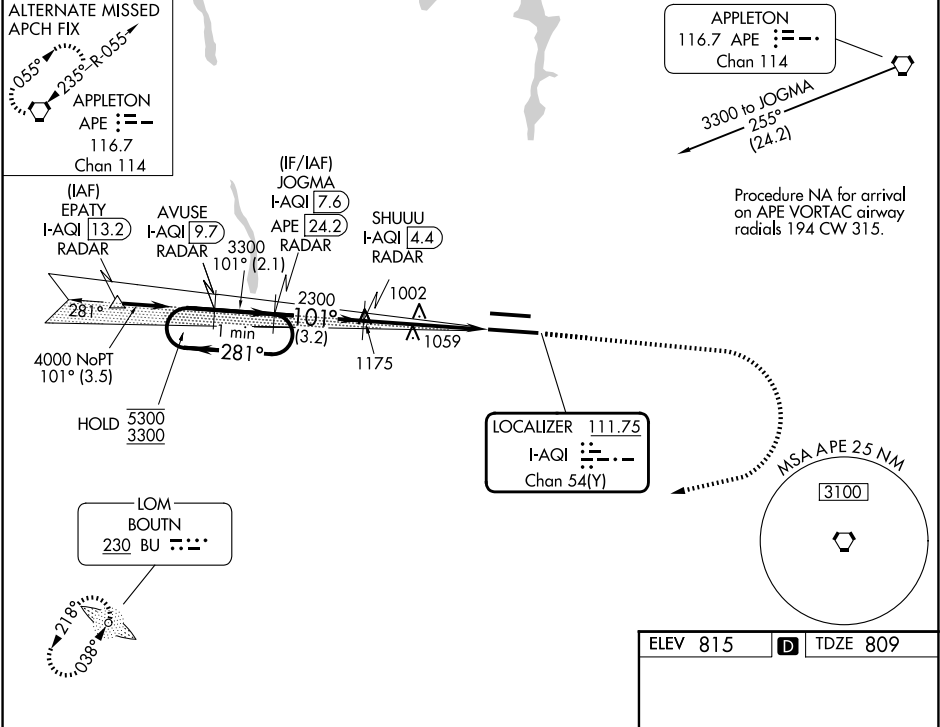

EC-2, 06 AUG 2026 to 03 SEP 2026

EC-2, 06 AUG 2026 to 03 SEP 2026