

WAAS CH 78144	APP CRS 053°	Rwy Ldg TDZE 716	7543
W05A		Apt Elev 716	

RNAV (GPS) RWY 5

WILLOW RUN (YIP)

RNP APCH - GPS.


▼

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -19°C or above 54°C. For inop ALS, increase LNAV/VNAV all Cats visibility to RVR 6000, LNAV Cats C/D visibility to 1 3⁄8 SM.

MALSR

MISSED APPROACH: Climb to 1200 then climbing left turn to 3000 direct SVM VORTAC and hold.

ATIS 127.425	DETROIT APP CON 118.95 284.0	WILLOW RUN TOWER 125.275 256.9	GND CON 119.975
------------------------	--	--	---------------------------

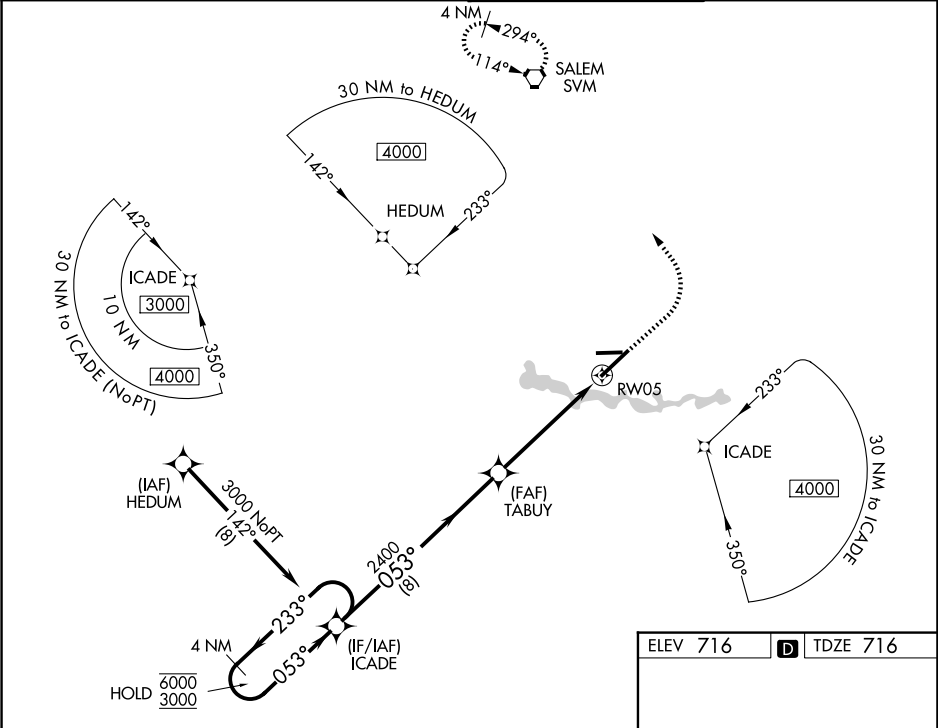

4 NM Holding Pattern		VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 75).		1200	3000	SVM
ICADE		TABUY		2400	1.2 NM to RW05	RW05
6000 ← 233° 3000 ← 053°		2400		8 NM		
GP 3.00° TCH 59		2400		3.9 NM		
CATEGORY		A		B		
LPV DA		916/18		200 (200-½)		
LNAV/VNAV DA		1121/40		405 (500-¾)		
LNAV MDA		1200/24		484 (500-½)		
CIRCLING		1220-1		504 (600-1)		
				1220-1½		
				504 (600-½)		
				1400-2¼		
				684 (700-2¼)		

