

APP CRS	Rwy Ldg	7597
306°	TDZE	55
	Apt Elev	62

RNAV (RNP) Z RWY 30R
NORMAN Y MINETA SAN JOSE INTL (SJC)

RNP AR APCH.

T For uncompensated Baro-VNAV systems, procedure NA below 1°C or above 54°C.


MISSED APPROACH: Climb to 600 then climb to 2000 direct ARTAQ and hold.

D-ATIS
126.95


NORCAL APP CON
120.1 290.25

SAN JOSE TOWER★
124.0 (CTAF) **L** 257.6

GND CON
121.7

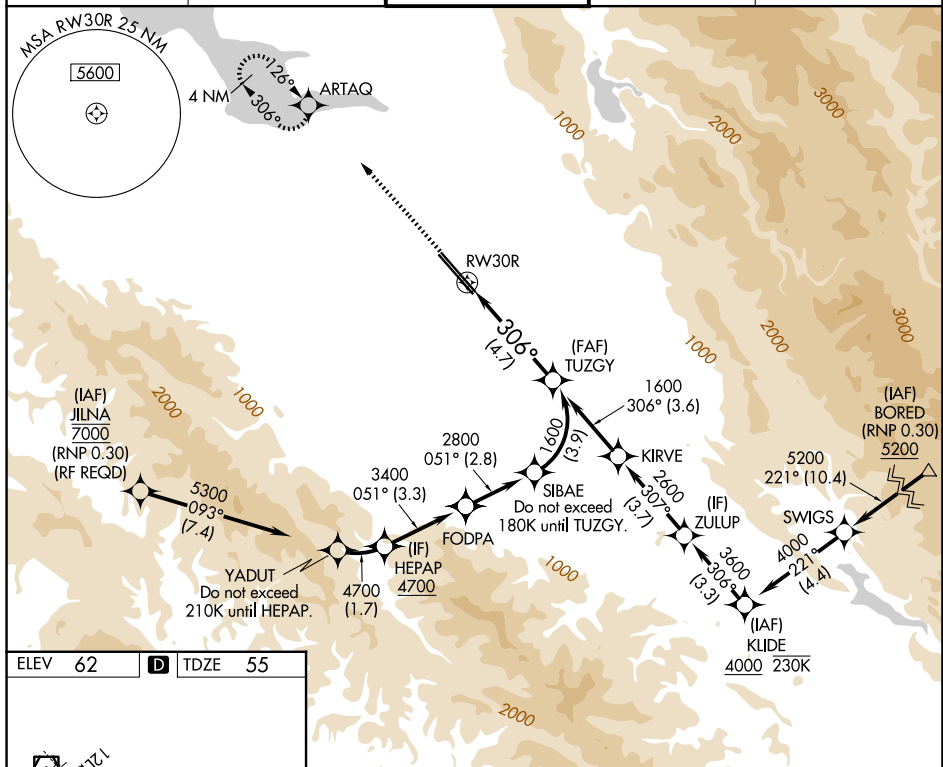UNICOM
122.95

ELEV	62	D	TDZE	55
------	----	----------	------	----

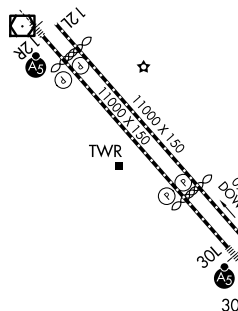

600	2000	ARTAQ
		

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 69).

See planview for multiple IF locations.

RW30R

	CATEGORY
--	----------

CATEGORY	
RNP 0.11 DA	

RNP 0.20 DA	
-------------	--

RNF 0.20 DA	
RNF 0.30 DA	

AUTHORIZATION REQUIRED

SAN JOSE, CALIFORNIA

Amdt 3 02DEC21

NORMAN Y MINETA SAN JOSE INTL (SJC)

37°22'N-121°56'W

RNAV (RNP) Z RWY 30R

SW-2, 06 AUG 2026 to 03 SEP 2026