

APP CRS
137°

Rwy Ldg
TDZE
27

Apt Elev
29

RNAV (RNP) Y RWY 14

JACKSONVILLE INTL (JAX)


RNP AR APCH - GPS.

MALSR

For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C.
GPS required. For inop MALSR, increase RNP 0.30 all Cats visibility to 1½ mile.

MISSED APPROACH: Climb to 500 then climbing left turn to 2000 direct YEJWO and hold.

D-ATIS 125.85	JACKSONVILLE APP CON 119.0 269.9	JACKSONVILLE TOWER 118.3 317.7	GND CON 121.9 348.6
-------------------------	--	--	-------------------------------

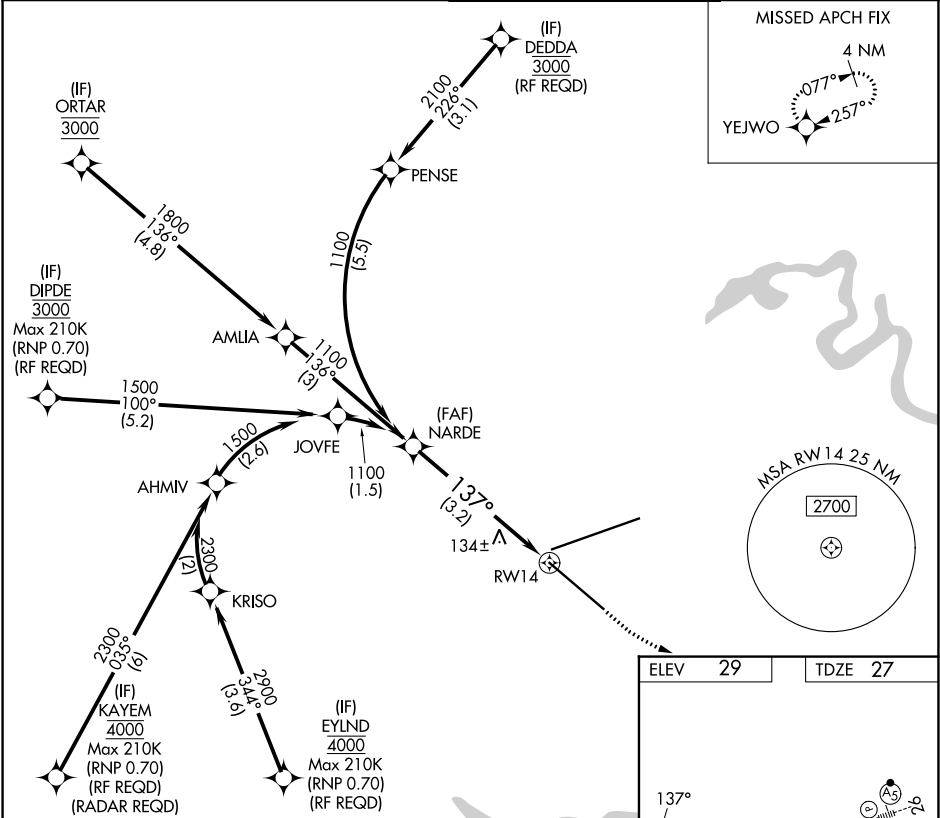

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 70).

500 2000 YEJWO

GP 3.00° TCH 54

See planview for multiple IF locations.

3.2 NM

CATEGORY	A	B	C	D
RNP 0.30 DA	389-1 362 (400-1)			

AUTHORIZATION REQUIRED

REIL Rwy 32
TDZL/RCLS Rwy 8, 14, and 26
HIRL Rwy 8-26 and 14-32