

APP CRS
353°

Rwy Ldg
16000

TDZE
5327

Apt Elev
5434

RNAV (RNP) Z RWY 34L

DENVER INTL (DEN)


RNP AR APCH - GPS. Authorization required.

ALSF-2

MISSED APPROACH: Climb to 5900 then climbing left turn to 11000 direct HYGEN and hold.

Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -26°C or above 54°C. For inop ALS, increase RNP 0.10 all Cats visibility to RVR 4000.

D-ATIS 125.6 379.9	DENVER APP CON 119.3 307.3 (N) 120.35 379.3 (S)	DENVER TOWER 135.3 351.95	GND CON 121.35 379.175 (W) 121.85 377.1 (E)
------------------------------	---	-------------------------------------	---

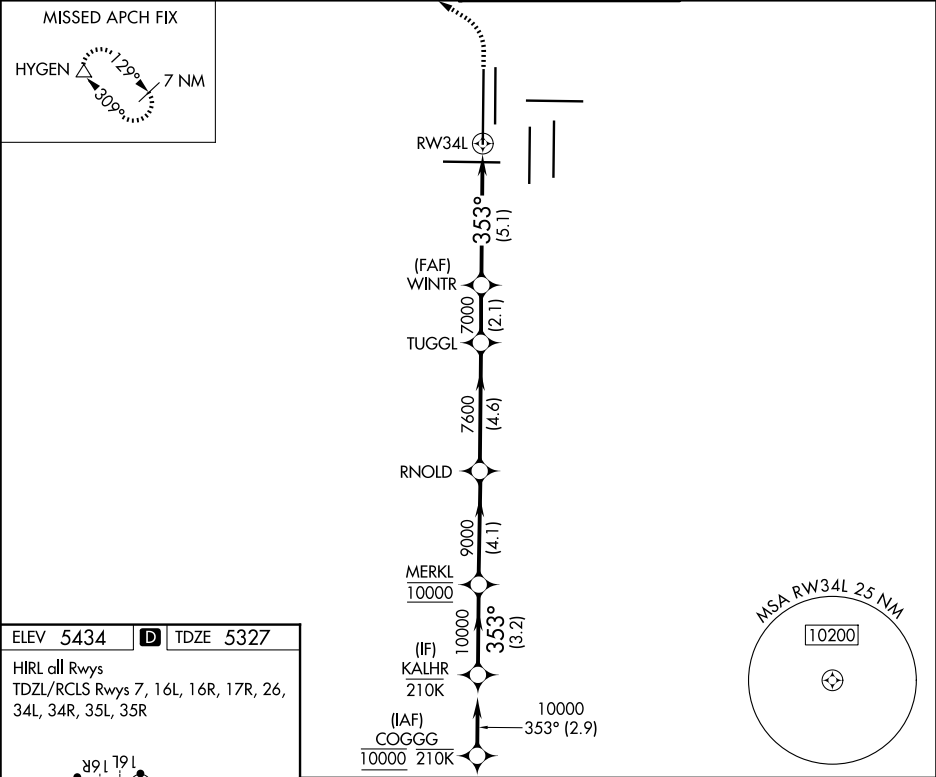

VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 70).				
KALHR	MERKL	RNOLD	TUGGL	WINTR
10000	10000	9000	7600	7000
GP 3.00°				
TCH 55				
3.2 NM 4.1 NM 4.6 NM 2.1 NM 5.1 NM				
CATEGORY	A	B	C	D
RNP 0.10 DA	5587/24 260 (200-½%)			
RNP 0.20 DA	5720/35 393 (300-¾%)			
RNP 0.30 DA	5782/45 455 (400-¾%)			

AUTHORIZATION REQUIRED

SW-1, 06 AUG 2026 to 03 SEP 2026

SW-1, 06 AUG 2026 to 03 SEP 2026