


APP CRS	Rwy Ldg	10000
036°	TDZE	645
	Apt Elev	645

RNAV (RNP) X RWY 4L

DETROIT METRO WAYNE COUNTY (DTW)

RNP AR APCH. Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -19°C or above 54°C. For inop ALS, increase RNP 0.30 DA all Cnts visibility to RVR 6000.		ALSF-2 	MISSED APPROACH: Climb to 1100 then climbing left turn to 4000 direct DOHNT and hold.
D-ATIS 133.675	DETROIT APP CON 124.05 284.0	METRO TOWER 135.0 317.725	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)

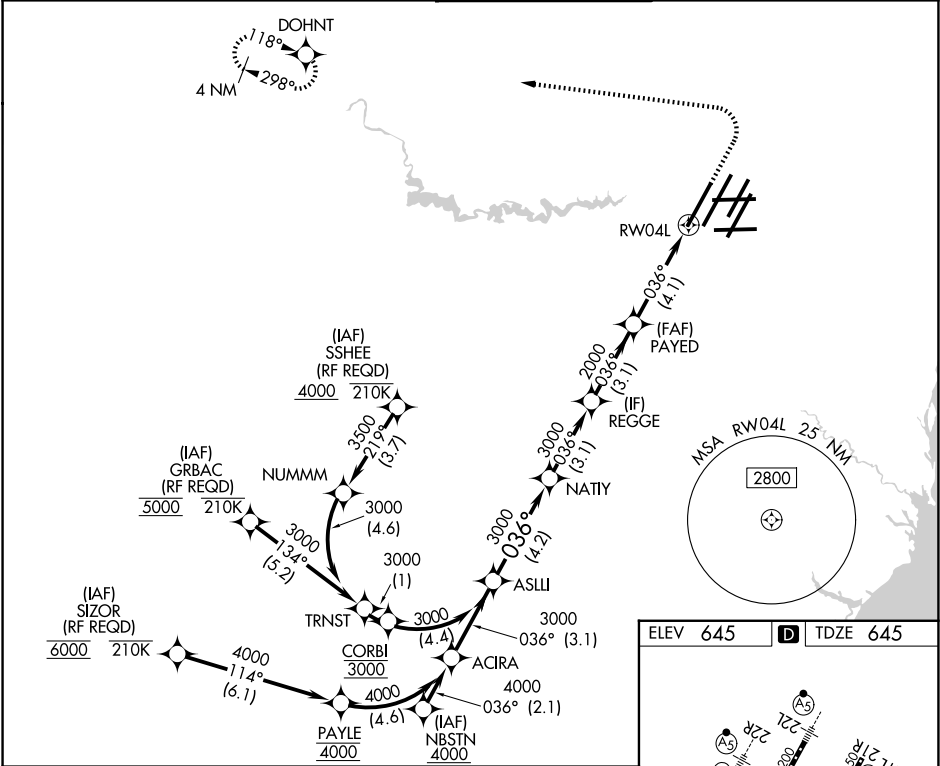

VGSi and RNAV glidepath not coincident (VGSi Angle 3.00/TCH 71).				1100 ↑	4000 ↷	DOHNT ✦	
ASLLI	NATY	REGGE	PAYD				
3000	036°	3000	3000	2000	RW04L		
GP 3.00° TCH 55				2000			
	4.2 NM		3.1 NM	3.1 NM	4.1 NM		
CATEGORY	A		B	C	D		
RNP 0.15 DA			970/26	325 (400-½)			
RNP 0.30 DA			1058/40	413 (500-¾)			
AUTHORIZATION REQUIRED							TDZL/RCLS Rwy 3R, 4L, 4R and 22R REIL Rwy 3L, 9L, 9R and 21R HIRL all Rwy