


APP CRS	Rwy Ldg	12002
344°	TDZE	4225
	Apt Elev	4231

RNAV (RNP) Z RWY 34R

SALT LAKE CITY INTL (SLC)

RNP AR APCH - GPS. Authorization required.	ALSF-2	MISSED APPROACH: Climb to 9000 direct TCH VORTAC and on track 336° to OGD VORTAC and hold.
For uncompensated Baro-VNAV systems, procedure NA below -9°C or above 54°C. Simultaneous approach authorized.		

D-ATIS 124.75 125.625	SALT LAKE CITY APP CON 125.7 284.6	SALT LAKE CITY TOWER 119.05 257.8	GND CON 123.775 348.6
--------------------------	---------------------------------------	--------------------------------------	--------------------------

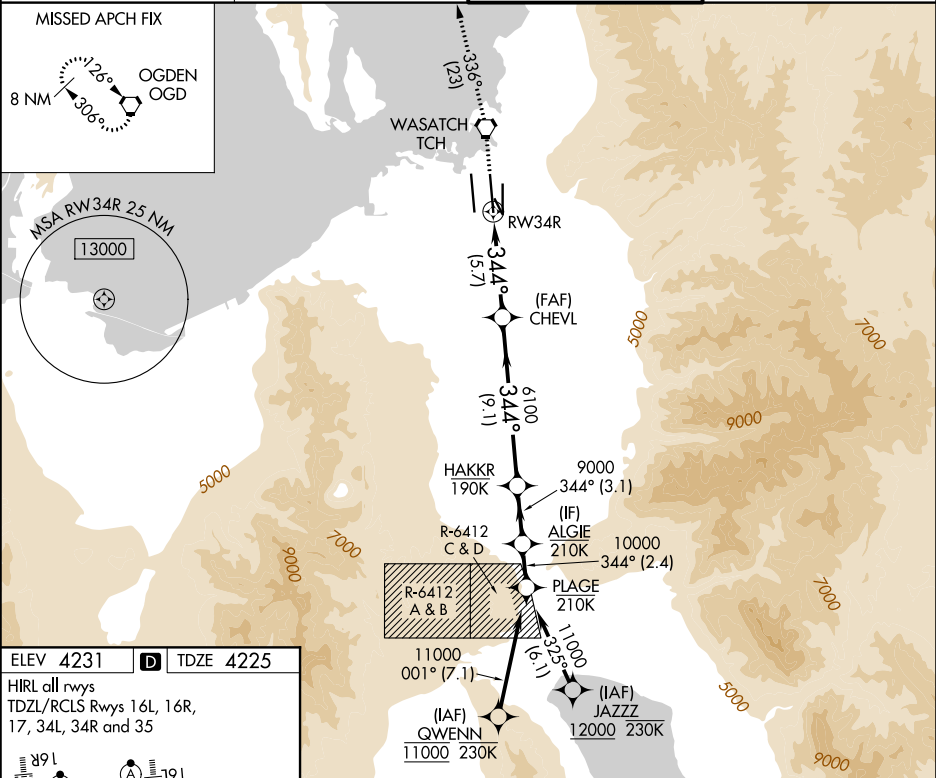

ELEV 4231 **D** TDZE 4225

HIRL all rwns
TDZL/RCLS Rwns 16L, 16R,
17, 34L, 34R and 35

Diagram details: 89L, 19L, 34L, 34R, 35, 344°, 12002 X 150, 3596 X 150, 12000 X 150, TWR, 344°, 351°, 344°, 351°, 344°, 351°.

9000 TCH	tr 336°	OGD	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 73).		PLAGE
			CHEVL	HAKKR	ALGIE
			6100	9000	11000
			344°	344°	10000
			5.7 NM	9.1 NM	3.1 NM
			2.4 NM		
					GP 3.00°
					TCH 55
CATEGORY	A	B	C	D	
RNP 0.10 DA		4546/26	321 (400-½)		
RNP 0.30 DA		4609/35	384 (400-¾)		
AUTHORIZATION REQUIRED					

SW-4, 03 SEP 2026 to 01 OCT 2026

SW-4, 03 SEP 2026 to 01 OCT 2026