



LOC/DME I-SYR 109.9 Chan 36	APP CRS 280°	Rwy Ldg TDZE 413 Apt Elev 421
---	------------------------	---

ILS RWY 28 (SA CAT I)
SYRACUSE HANCOCK INTL (SYR)

DME or RADAR required. Requires specific OPSPEC, MSPEC, or LOA approval and use of HUD to DH.		ALSF-2	MISSED APPROACH: Climb to 1100 then climbing right turn to 3000 direct SYR VORTAC and hold, continue climb-in-hold to 3000.
ATIS 124.225	SYRACUSE APP CON 126.125 269.125	SYRACUSE TOWER 120.3 239.0	GND CON 121.7 348.6

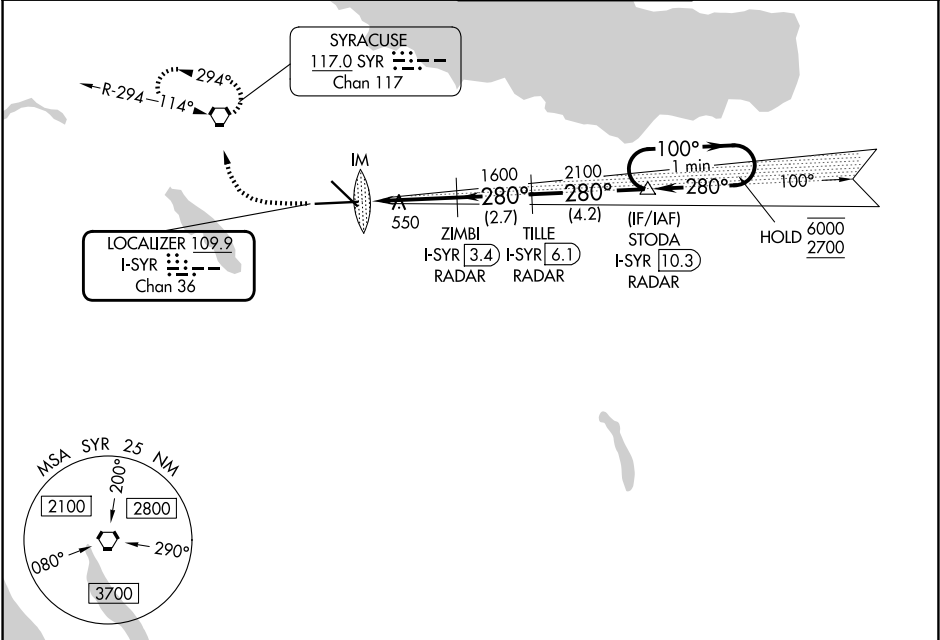

ELEV 421	D	TDZE 413
-----------------	----------	-----------------

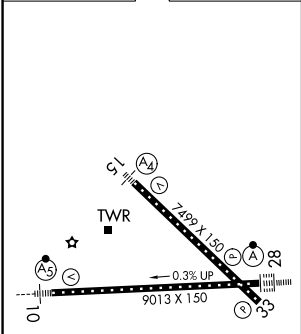

1100	3000	SYR	STODA I-SYR 10.3 RADAR	One Minute Holding Pattern
IM	ZIMBI I-SYR 3.4 RADAR	TILLE I-SYR 6.1 RADAR	I-SYR 10.3 RADAR	100° → 6000 ← 280° 2700
1600	1600	2100	280°	GS 3.00° TCH 60
975'	3.6 NM	2.7 NM	4.2 NM	
CATEGORY	A	B	C	D
S-ILS 28	RA 150/14 150 DA 563			

SA CATEGORY I ILS - SPECIAL AIRCREW
& AIRCRAFT CERTIFICATION REQUIRED

TDZ/CL Rwy 28
HIRL Rwy 10-28 and 15-33

NE-2, 03 SEP 2026 to 01 OCT 2026

NE-2, 03 SEP 2026 to 01 OCT 2026