

WAAS CH 40017 W10A	APP CRS 100°	Rwy Ldg TDZE 421 Apt Elev 421	9013
--	------------------------	---	-------------

RNAV (GPS) Z RWY 10
SYRACUSE HANCOCK INTL (SYR)


RNP APCH - GPS.

For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -19°C or above 54°C. For inop ALS, increase LNAV Cats C/D visibility to RVR 5500. # RVR 1800 authorized with use of FD or AP or HUD to DA.

MALSR

MISSED APPROACH: Climb to 3200 direct STODA and hold, continue climb-in-hold to 3200.

ATIS 124.225	SYRACUSE APP CON 126.125 269.125	SYRACUSE TOWER 120.3 239.0	GND CON 121.7 348.6
------------------------	--	--------------------------------------	-------------------------------

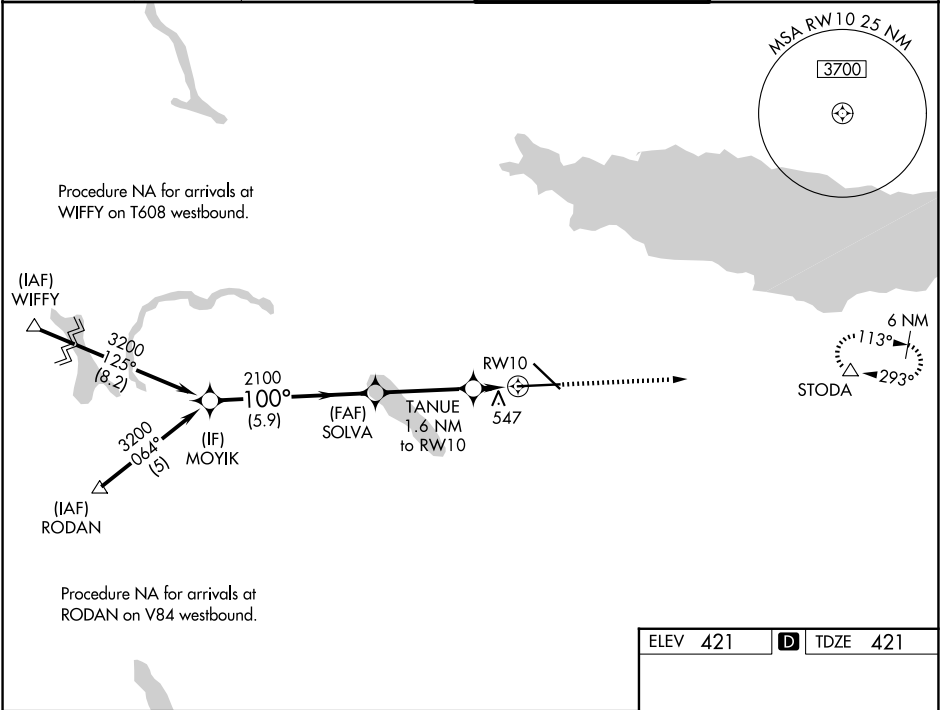

MOYIK				SOLVA		TANUE		STODA	
3200		2100		2100		1.6 NM to RW10		3200 ↑ △	
GP 3.00° TCH 55		2100		*980		*1 NM to RW10		*LNAV only	
100°		5.9 NM		3.5 NM		0.6 NM		1 NM	
A		B		C		D			
LPV	DA#	621/24 200 (200-½)							
LNAV/ VNAV	DA	846/40 425 (500-¾)							
LNAV	MDA	800/24 379 (400-½)				800/35 379 (400-¾)			
CIRCLING		900-1 479 (500-1)		920-1 499 (500-1)		1020-1½ 599 (600-1½)		1180-2½ 759 (800-2½)	

ELEV 421 TDZE 421

TDZ/CL Rwy 28
HIRL Rwy 10-28 and 15-33