



|            |         |          |      |
|------------|---------|----------|------|
| VORTAC SPI | APP CRS | Rwy Ldg  | 8001 |
| 112.7      | 215°    | TDZE     | 598  |
| Chan 74    |         | Apt Elev | 598  |

VOR RWY 22

ABRAHAM LINCOLN CAPITAL (SPI)

|                                                                                                                                                                                                                                                                                                                                                                      |  |        |                                                                                                |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|--------|------------------------------------------------------------------------------------------------|
| DME required.                                                                                                                                                                                                                                                                                                                                                        |  | MALS R | MISSED APPROACH: Climb to 2400 on SPI VORTAC R-215 then right turn direct SPI VORTAC and hold. |
| VDP NA when using AAA altimeter setting. When local altimeter setting not received, use AAA altimeter setting: increase all MDA 60 feet and S-22 visibility Cat C/D ¼ SM, and Circling Cat C/D visibility ¼ SM. For inop ALS, increase S-22 Cat C/D visibility to 1 ¾ SM. For inop ALS when using AAA altimeter setting, increase S-22 Cat C/D visibility to 1 ¾ SM. |  |        |                                                                                                |

|              |                     |                      |             |        |
|--------------|---------------------|----------------------|-------------|--------|
| ATIS         | SAINT LOUIS APP CON | SPRINGFIELD TOWER ★  | GND CON     | UNICOM |
| 127.65 270.1 | 126.15 323.0        | 121.3 (CTAF) 0 257.8 | 121.9 348.6 | 122.95 |

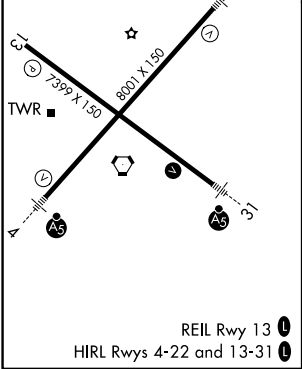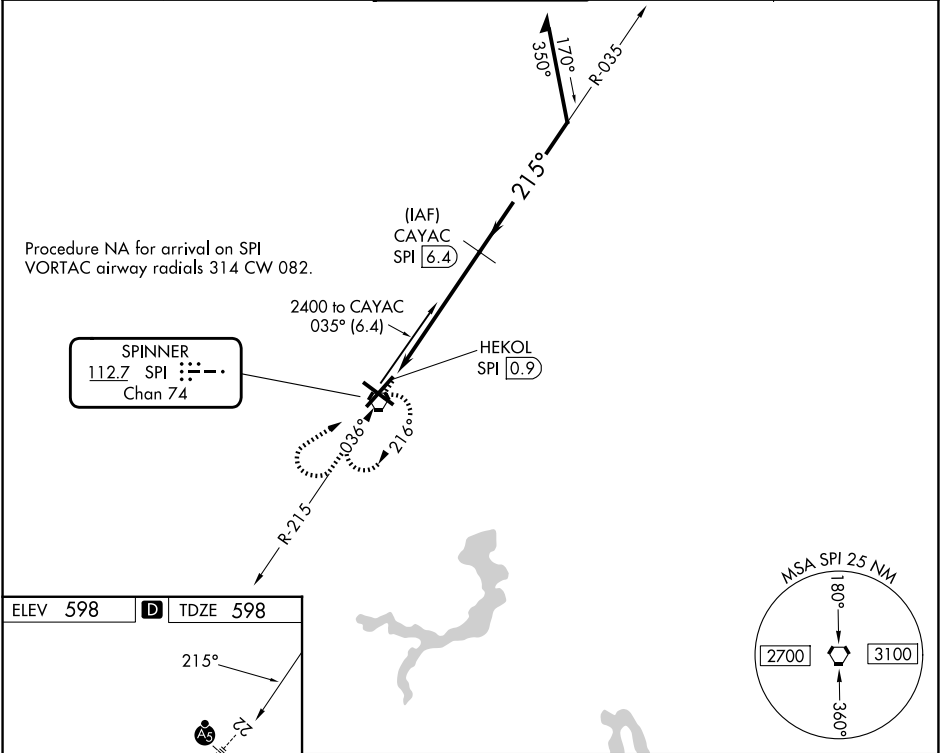

|            |        |             |                         |                         |                     |
|------------|--------|-------------|-------------------------|-------------------------|---------------------|
| 2400       |        | SPI         | CAYAC SPI 6.4           |                         | Remain within 10 NM |
| SPI R-215  |        |             | HEKOL SPI 0.9           |                         |                     |
| SPI VORTAC |        |             | HEKOL SPI 0.9           |                         |                     |
| 1.4        |        |             | 4.1 NM                  |                         |                     |
| CATEGORY   | A      | B           | C                       | D                       |                     |
| S-22       | 1100-½ | 502 (600-½) | 1100-1                  | 502 (600-1)             |                     |
| CIRCLING   | 1100-1 | 502 (600-1) | 1360-2¼<br>762 (800-2¼) | 1380-2½<br>782 (800-2½) |                     |