

LOC I-HFE <u>111.7</u>	APP CRS 281°	Rwy Ldg 10102 TDZE 1174 Apt Elev 1203
----------------------------------	------------------------	--

ILS or LOC RWY 28R
PITTSBURGH INTL (PIT)


From NASTY: RADAR required for procedure entry.
RADAR required for LOC only.

MALSR

MISSED APPROACH: Climb to 1800 then climbing right turn to 5000 direct EWC VOR/DME and hold.

T Simultaneous approach authorized. For inop ALS, increase S-ILS 28R Cat E visibility to RVR 4000 and S-LOC 28R Cats C/D/E visibility to RVR 5500. DME from **A** MMJ DME. Simultaneous reception of I-HFE and MMJ DME required.

D-ATIS 127.25	PITTSBURGH APP CON 123.95 360.8	PITTSBURGH TOWER 128.3 291.7	GND CON SOUTH 121.9 348.6 NORTH 127.8 348.6
------------------	------------------------------------	---------------------------------	---

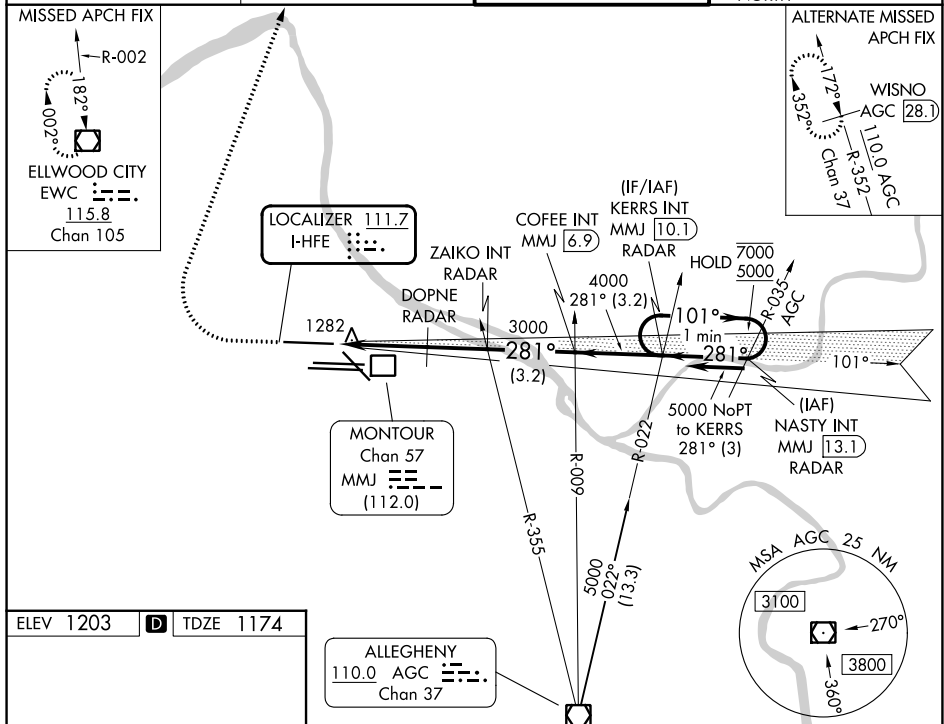

REIL Rwy 10C
HIRL all rwys
TDZL/RCLS Rwys 10L, 10R, 28L, 28R, 28C, and 32

FAF to MAP 5.6 NM

	Knots	60	90	120	150	180
Min:Sec	5:36	3:44	2:48	2:14	1:52	

Approach Parameters:

CATEGORY	A	B	C	D	E
S-ILS 28R	1374/18 200 (200-½)				
S-LOC 28R	1540/24	366 (400-½)	1540/35 366 (400-⅝)		

Circling Minima:

	1700-1	497 (500-1)	1880-2	1880-2¼	1880-2½
CIRCLING	1700-1	497 (500-1)	1880-2 677 (700-2)	1880-2¼ 677 (700-2¼)	1880-2½ 677 (700-2½)