
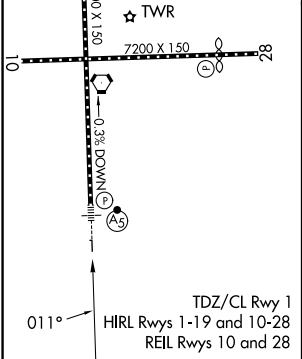


APP CRS 011°	Rwy Ldg TDZE 284 Apt Elev 285	RNAV (RNP) Z RWY 1 ALBANY INTL (ALB)	
------------------------	---	---	--

GPS required. For uncompensated Baro-VNAV systems, procedure NA below -15°C (3°F) or above 47°C (117°F). For inoperative MALSR, increase RNP 0.15 visibility to 1½ and RNP 0.30 visibility to 1½.	MALSR MISSED APPROACH: Climb to 3000 on track 011° to OXFIC and on track 357° to OTOLE and hold.
--	--

D-ATIS 120.45	ALBANY APP CON 132.825 307.2	ALBANY TOWER 119.5 257.8	GND CON 121.7 348.6	CLNC DEL 127.50
-------------------------	--	------------------------------------	-------------------------------	---------------------------

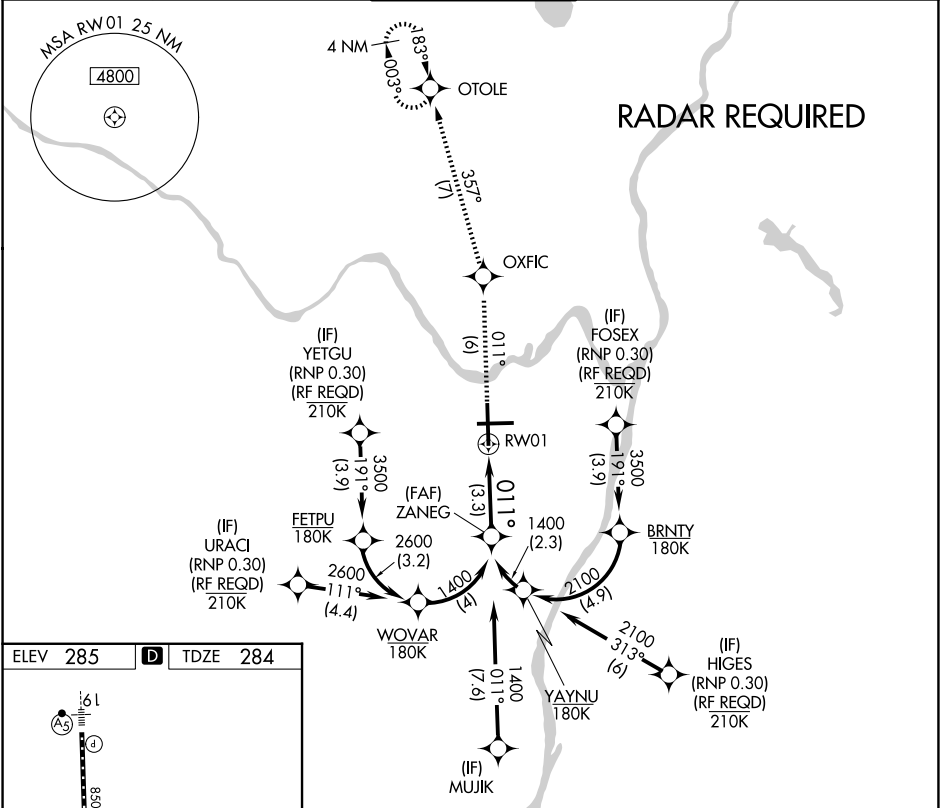

3000	OXFIC	OTOLE	ZANEG	
	tr 011°		tr 357°	
				
See planview for multiple IF locations.				
CATEGORY	A	B	C	D
RNP 0.15 DA	656/40		372 (400-¾)	
RNP 0.30 DA	727/50		443 (500-1)	
AUTHORIZATION REQUIRED				

NE-2, 01 OCT 2026 to 29 OCT 2026

NE-2, 01 OCT 2026 to 29 OCT 2026