

WAAS CH 63231 W13A	APP CRS 132°	Rwy Ldg 7399 TDZE 19 Apt Elev 22
--	------------------------	---

RNAV (GPS) RWY 13

BROWNSVILLE/SOUTH PADRE ISLAND INTL (BRO)


▼ Circling to Rwy 18 NA at night. For uncompensated Baro-VNAV systems, procedure NA below 3°C (38°F) or above 54°C (130°F). DME/DME RNP-0.3 NA. When local altimeter setting not received use Port Isabel altimeter setting and increase LPV DA to 257 feet and LNAV/VNAV DA to 411 feet and all MDA 40 feet; increase LNAV/VNAV visibility all Cots to RVR 4500. LNAV visibility Cat C and D to RVR 5500. VDP and Baro-VNAV NA when using Port Isabel altimeter setting. For inop MALS/R, increase LNAV Cat C/D visibility to 1½ mile.

▲ ** RVR 1800 authorized with use of FD or AP or HUD to DA, NA when using Port Isabel altimeter setting.

MALSR

MISSED APPROACH:
Climb to 500 then
climbing left turn to
2000 direct FIRTA
and hold.

ATIS 128.55	VALLEY APP CON 119.5 257.6	BROWNSVILLE TOWER ★ 118.9 (CTAF) 0 239.3	GND CON 121.9	UNICOM 122.95
-----------------------	--------------------------------------	--	-------------------------	-------------------------

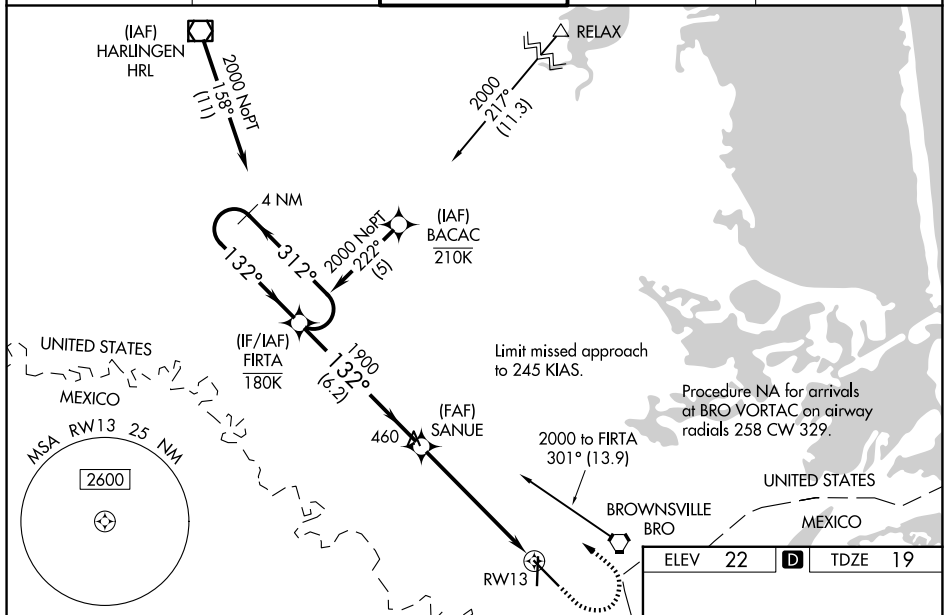

4 NM Holding Pattern

2000 ← 312° → 132°

FIRTA

SANUE

1900

1900

6.2 NM

4.4 NM

1.3 NM

GP 3.00° TCH 55

* LNAV only

500

2000

FIRTA