

APP CRS	Rwy Ldg	10000
003°	TDZE	707
	Apt Elev	748

RNAV (RNP) Z RWY 1R
CHARLOTTE/DOUGLAS INTL (CLT)



RNP AR APCH - GPS.


Simultaneous approach authorized. Use of FD or AP required during simultaneous operations. For uncompensated Baro-VNAV systems, procedure NA below -7°C or above 54°C. For inop ALS, increase RNP 0.30 visibility all Cats to 1 1/2 SM.

ALS-2

MISSED APPROACH: Climb to 3000 on track 003° to TOMME and hold.

D-ATIS	CHARLOTTE APP CON		CHARLOTTE TOWER		GND CON
121.15	128.325 (001°-119°)	257.2 (180°-359°)	118.1 257.8 (18-36)		121.8 348.6 (W)
	120.05 (120°-295°)	307.8 (360°-179°)	126.4 257.8 (1R-19L)		121.9 348.6 (E)
	134.75 (296°-360°)		133.35 257.8 (1L-19R)		

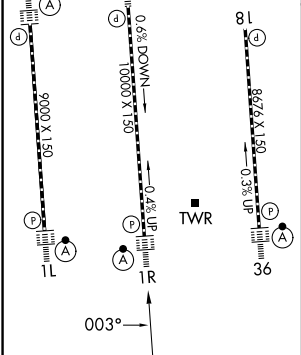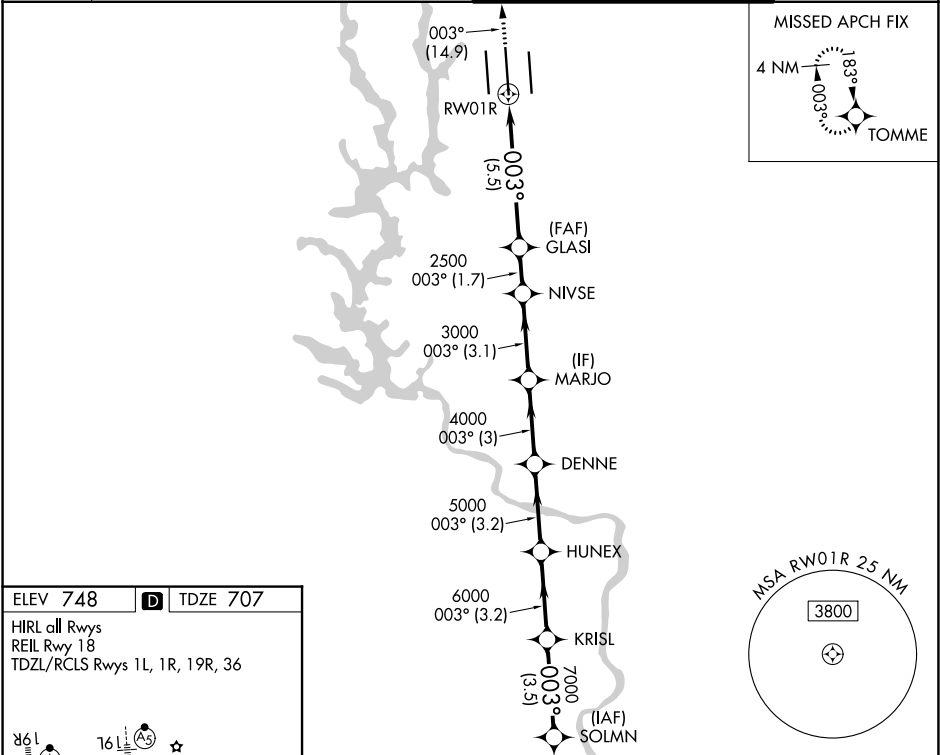

3000	tr 003°	TOMME	VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 72).					SOLMN	
									
			GLASI 2500	NIVSE 3000	MARJO 4000	DENNE 5000	HUNEX 6000	KRISL 7000	003° 8000
									GP 3.00° TCH 54
CATEGORY		A		B		C		D	
RNP 0.11 DA		1134/40		427 (400-¾)					
RNP 0.30 DA		1180/50		473 (500-1)					
AUTHORIZATION REQUIRED									