


LOC/DME I-AQI 111.75 Chan 54 (Y)	APP CRS 101°	Rwy Ldg 10114 TDZE 809 Apt Elev 815
--	------------------------	--

ILS RWY 10R (SA CAT I & II)
JOHN GLENN COLUMBUS INTL (CMH)

ADF required. DME or RADAR required.	MALSR	MISSED APPROACH: Climb to 1400 then climbing right turn to 3000 direct BU LOM and hold.
Simultaneous approach authorized. SA CAT I, SA CAT II: Requires specific OPSPEC, MSPEC, or LOA approval.		

D-ATIS 124.6	COLUMBUS APP CON 125.95 371.975	COLUMBUS TOWER 132.7 257.8	GND CON 121.9 348.6
------------------------	---	--------------------------------------	-------------------------------

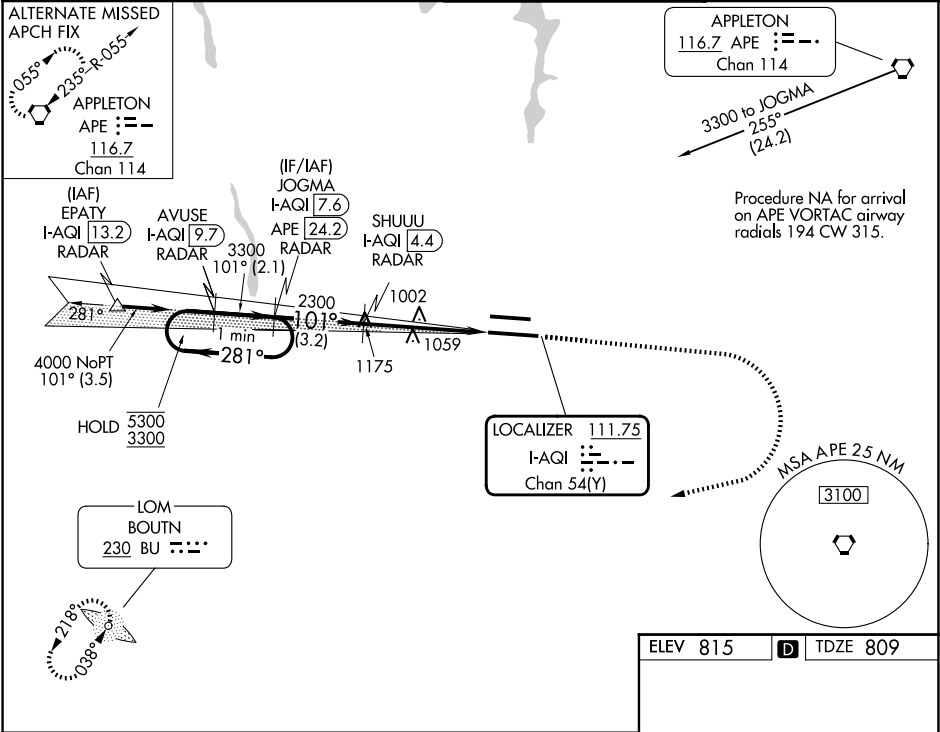

EC-2, 01 OCT 2026 to 29 OCT 2026

EC-2, 01 OCT 2026 to 29 OCT 2026