

APP CRS
101°

Rwy Ldg
TDZE
Apt Elev
8000
815
815

RNAV (RNP) Z RWY 10L
JOHN GLENN COLUMBUS INTL (CMH)


RNP APCH AR - GPS. Authorization required. From HINDO or ELTEE: RF.

Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -14°C or above 54°C. For inop ALS, increase RNP 0.30 all Cats visibility to RVR 6000.

MALSR

MISSED APPROACH:
Climb to 1400 then climbing left turn to 3000 direct APE
VORTAC and hold.

D-ATIS 124.6	COLUMBUS APP CON 125.95 371.975	COLUMBUS TOWER 132.7 257.8	GND CON 121.9 348.6
------------------------	---	--------------------------------------	-------------------------------

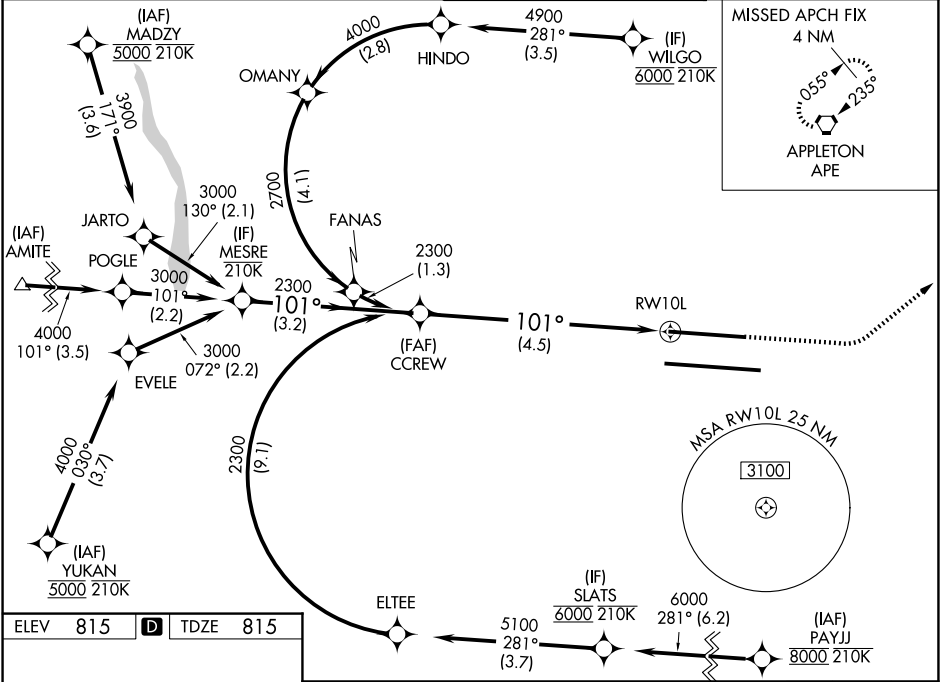

101°

CCREW
2300

101°

See planview for multiple IF locations.

RWY 10L

4.5 NM

CATEGORY	A	B	C	D
RNP 0.13 DA	1148/26 333 (400-½)			
RNP 0.26 DA	1198/35 383 (400-¾)			
RNP 0.30 DA	1216/40 401 (500-¾)			

AUTHORIZATION REQUIRED

COLUMBUS, OHIO
Amdt 4 22JAN26

40°00'N-82°54'W

JOHN GLENN COLUMBUS INTL (CMH)
RNAV (RNP) Z RWY 10L