

APP CRS
265°

Rwy Ldg
TDZE
Apt Elev

9025
3962
3962

RNAV (RNP) Z RWY 26L
EL PASO INTL (ELP)


ASR

For uncompensated Baro-VNAV systems, procedure NA below -8°C (18°F) or above 50°C (122°F). For inop MALS, increase RNP 0.30 visibility all Cats to 1 mile. GPS required.

MALS

MISSED APPROACH: Climb to 4400, then climbing right turn to 7500 direct FABAN and hold.

D-ATIS 120.0 254.3	EL PASO APP CON 124.25 298.85	EL PASO TOWER 118.3 239.275	GND CON 121.9 348.6
-----------------------	----------------------------------	--------------------------------	------------------------

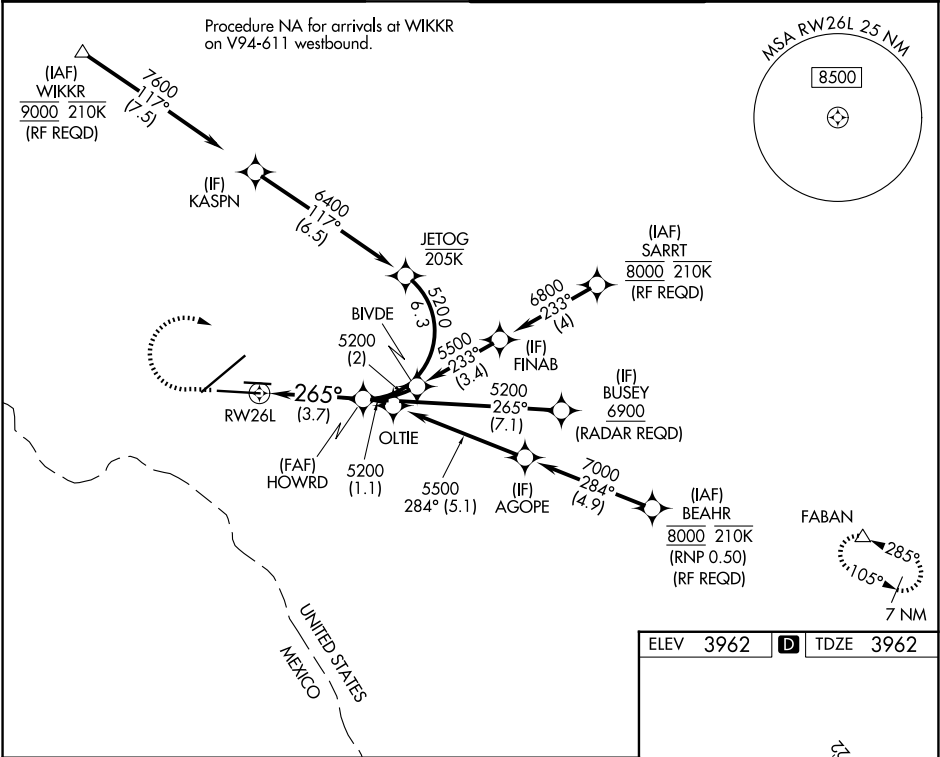

4400 7500 FABAN

VGSI and glidepath not coincident (VGSI Angle 3.00/TCH 75).

See planview for multiple IF locations.

RW26L
265°
5200
GP 3.00°
TCH 55
3.7 NM

CATEGORY	A	B	C	D
RNP 0.30 DA	4275-½ 313 (400-½)			

AUTHORIZATION REQUIRED

ELEV 3962 TDZE 3962

12020 X 150
5499 X 75
9025 X 150
TWR
26L
265°